

TABLE OF DIMENSIONS OF CHIMNEYS.

On the basis of the head of outside air being equal to half the height of Chimney, and the flues being not much over six times the length of boiler.

Height of Chimney in feet.	$W = \frac{A\sqrt{H}}{.07} =$ lbs. of coal per hour per 1 foot of area at top of Chimney.	$H_0 = 0.192 H_1 (.0761) =$ height in inches of column of water balanced by draught pressure.	$HP = \frac{A\sqrt{H}}{.75} =$ Horse power of each sq. ft. of Chimney. Assuming 7 lbs. of coal per horse power.	$A = \frac{.8}{\sqrt{H}} =$ area of top of Chimney in feet per H. P. for 1 or 2 boilers.	$A = \frac{.5}{\sqrt{H}} =$ area of top of Chimney in ft. per H. P. where several boilers are working together.	$A = \frac{1.}{\sqrt{H}} =$ area of flue in feet per horse power.
30	78.24	.218	7.3	.146	.091	.182
40	90.35	.296	8.4	.126	.077	.155
50	101.01	.364	9.4	.113	.070	.140
60	110.65	.437	10.3	.103	.064	.129
70	119.52	.5	11.2	.095	.059	.119
80	127.77	.58	11.9	.089	.055	.111
90	135.52	.656	12.6	.084	.052	.105
100	142.85	.729	13.3	.08	.05	.101
125	159.71	.911	14.9	.071	.044	.089
150	174.96	1.09	16.3	.065	.04	.082
175	188.98	1.26	17.6	.060	.038	.075
200	202.03	1.45	18.8	.056	.035	.07
225	214.28	1.64	20	.053	.033	.066
250	225.87	1.82	21	.05	.031	.063
275	236.90	1.99	22	.048	.03	.06
300	247.43	2.18	23	.046	.028	.057

When the area at top is given as in fifth and sixth columns, the dimension of the side of square in a square chimney can easily be found by taking the square root of the area, or side of square $= \sqrt{A}$, and the diameter for a round chimney $= \sqrt{\frac{A}{.7854}}$. See p. 30.

BOILER AND FACTORY CHIMNEYS,

THEIR DRAUGHT-POWER AND STABILITY :

WITH A CHAPTER ON

LIGHTNING CONDUCTORS.

BY

ROBERT WILSON, A.I.C.E.,

AUTHOR OF "TREATISE ON STEAM BOILERS," "COMMON SENSE FOR GAS
USERS," ETC., ETC

Fourth Edition.



LONDON :

CROSBY LOCKWOOD & SON,
7, STATIONERS' HALL COURT, LUDGATE HILL.

1899.

3907

621.183

M99

BRADBURY, AGNEW, & CO. LD., PRINTERS,
LONDON AND TONBRIDGE.



PREFACE.

THE following Chapters were commenced with intention of adding them to the 5th Edition of the "Treatise on Steam Boilers," in consequence of having had numerous enquiries respecting the proper size of chimney for boiler-work. The information is, however, likely to be more useful in its present form, hence the appearance of this little book.

I had some diffidence in calling in question the correctness of the theory of draught adopted by Rankine, by Morin, and by Peclet in the 2nd Edition of his "*Traité de la Chaleur*," but after going to press I find that Peclet in the 3rd Edition of his work has altered his theory and adopted the same as I have arrived at.

ROBERT WILSON.

CONTENTS.



TABLE OF DIMENSIONS OF CHIMNEYS . . .	<i>Frontispiece.</i>
---------------------------------------	----------------------

CHAPTER I.

CHIMNEY DRAUGHT	PAGE 1
---------------------------	-----------

CHAPTER II.

STABILITY OF CHIMNEYS	31
---------------------------------	----

CHAPTER III.

DESCRIPTIONS OF CHIMNEYS	46
------------------------------------	----

CHAPTER IV.

LIGHTNING CONDUCTORS	54
--------------------------------	----



BOILER AND FACTORY CHIMNEYS.

CHAPTER I.

CHIMNEY DRAUGHT.


BOILER chimneys are used not only in order to obtain a sufficient flow of air to maintain a steady combustion, but also to discharge the noxious gases of combustion at such a height above the ground that they shall not be considered a nuisance.

It is well known that the pressure of a fluid is equal in all directions, and is measured at any given point by the area, density, and height above that point of the column of liquid or gas which exerts the pressure.

In fig. 1, let $AB=CD$ represent the height of the atmosphere, and DF the height of a chimney. Then the pressure on the top of the column of air in the chimney is measured by CF , and the pressure on the bottom of the same column by $CF + FD$. When the temperature and density of the column FD inside the chimney are the same as those of a column EB of equal height and area outside, it is evident that the two columns $AE + EB$ and $CF + FD$ will be in equilibrio, and there will be no tendency to produce motion. Should, however, the column FD inside the chimney be of a higher temperature and consequently of less density than a column EB of equal height and

area outside, the weight of the column $A E + E B$ will

Fig. 1.

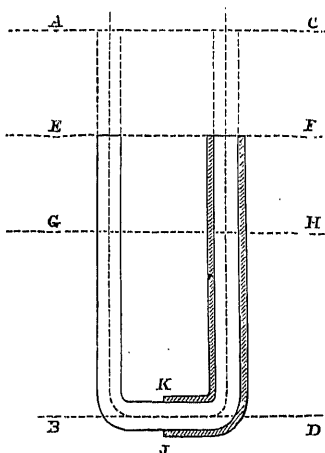

be greater than that of $C F + F D$, whence the preponderating pressure at $J K$ will force the inside column $F D$ upwards. If the air, as it passes $J K$, becomes heated, and the diminished density of the column inside the chimney is maintained, the column will continue to be forced upwards by the unbalanced pressure outside.

This is what takes place when a fire is lighted under a chimney, and the continuous current of cold air, that forces the heated and lighter air upwards, produces what is called the draught, which is the name given (wrongly) to the quantity of heated gas discharged by the chimney, whether expressed by weight or volume of the gases; or the velocity of the current; or by the pressure required to produce that current. It is evident that the force of the draught will depend upon the difference in the weight of the two columns $A E + E B$ and $C F + F D$. Now as $A E$ and $C F$, the height of the portions of the columns above the chimney, are equal, they balance each other, and may be left out of consideration for the present.

Assuming the temperature of the atmosphere to be 62° —a fair average—then every additional degree of

heat imparted to the air would increase its bulk $\frac{1}{523}$ or, by increasing its temperature by 523 degrees, its volume would be doubled, and its density consequently reduced by one-half.

Let $D = 0.0761$, the density or weight of a cubic foot of the outside air at 62° ;

d = the density of the hot gas in the chimney, assumed to be constant from the bridge to the chimney-top ;

t = the temperature of the hot gas in the chimney ;

then the density d of the hot gas at any required temperature t , can be found by the formula

$$d = .0761 \left(\frac{523}{461 + t} \right).$$

If we represent the weight of the heated column by DH in fig. 1, $FH = EG$ will represent the difference in weight or pressure between the two columns FD and EB .

Let H = the height of the chimney ;

P = the difference in pressure between the two columns ;

then $P = HD - Hd = H(D - d)$.

This unbalanced pressure P is the motive force which drives the hot-air up the chimney, and the height in feet of a column of the external air or "*head*" H_1 in feet of cold air, to produce this pressure, acting by its own weight, is found by dividing P by the density of the external air, whence

$$H_1 = \frac{P}{D} = \frac{H(D - d)}{D}$$

This head H , is represented graphically on fig. 1 by $FH = EG$, as before.

If we take, for example, a chimney 90 ft. high, in which the volume of the air is doubled in passing through the fire, we shall have $D = 0.0761$ and $d = 0.0380$, whence

$$H_1 = 90 \left(\frac{.0761 - .0380}{.0761} \right) = 90 \left(\frac{1}{2} \right) = 45 \text{ ft.}$$

The head is proportional to the height of the chimney.

When we know

t = the temperature of the chimney gases above zero ;

T = the temperature of the atmosphere ;

a = the coefficient of expansion of air for one degree of the thermometer at zero = 0.00217 ;

we have

$$H_1 = H \left(\frac{D - d}{D} \right) = a \left(\frac{t - T}{1 + a t} \right) H.$$

Taking t_1 = the temperature of the gases above that of the atmosphere at 62° , which makes $T = 62^\circ$, we have the following simple rule

$$H_1 = \frac{t_1}{523 + t_1} H.$$

Suppose the temperature of the gas inside the chimney to be 600° , then

$$t_1 = 600^\circ - 62^\circ = 538^\circ, \text{ and}$$

$$H_1 = \frac{538}{1061} H = 0.574, \text{ or very nearly one half the height of the chimney.}$$

When the head is known, the theoretical mean velocity per second with which the external air tends to enter the chimney can easily be calculated. Supposing the chimney were quite empty, and there were no loss by contraction at entrance, then, if a column of outside

air were allowed to descend into it by its own weight, the velocity which the column would acquire by the time its top reached the entrance into the chimney would be that due to the height the column had fallen, which would be equal to the height of the chimney, and the velocity of the entering air would be $= \sqrt{2 g H} = 8 \sqrt{H}$, $2 g$ being twice the velocity produced by gravity in the first second of fall.

But the chimney is never quite empty, and the height of the column to which the theoretical velocity, v , in feet per second, of the entering cold air is due, becomes equal to the square root of the height of the head H_1 , or the theoretical velocity of the cold air,—

$$v = \sqrt{2 g H \frac{D-d}{D}} = 8 \sqrt{H \frac{D-d}{D}}$$

$$v = 8 \sqrt{H a \frac{(t-T)}{1+at}} = 8 \sqrt{H \frac{t_1}{523+t_1}}$$

$$= 8 \sqrt{H_1}.$$

Suppose the head of cold air $H_1 = .5 H$ and $H = 90$, then $v = 8 \sqrt{45} = 53.7$.

On passing through the fire the air is increased in *volume* in proportion to the increase of temperature, but not by the amount of the bulk of the gases it enters into combination with (see p. 19). The velocity, therefore, of the heated air will be much greater than that of the entering cold air.

As the velocity of the gases is proportional to their volumes, we have for V , the theoretical velocity of the hot air in the chimney,

$$V = v \left(\frac{461+t}{523} \right) = 8 \sqrt{H_1 \left(\frac{461+t}{523} \right)} = 8 \sqrt{H_1} \times \frac{D}{d}.$$

Peclet, Rankine, and Morin have all taken the

head, in feet of *hot gas*, or $h_1 = H_1 \frac{D}{d}$ and make
 $V = \sqrt{2 G H \frac{D-d}{d}}$. This is evidently an error, since
 $\sqrt{\frac{D-d}{d}}$ is not equal to $\frac{D}{d} \sqrt{\frac{D-d}{D}}$. The velocity of
 the hot gases is always dependent in the first place upon
 the velocity of the entering cold air, and consequently
 upon H_1 and not upon the head of hot gas h_1 .

If Q = volume of gases discharged per second by
 the chimney ;

A = area of chimney ; we have

$$Q = V A = A 8 \sqrt{H \frac{D-d}{D}} \times \frac{D}{d} = A 8 \sqrt{H_1} \times \frac{D}{d}$$

$$= A 8 \sqrt{H a \frac{(t-T)}{1+at}} \times \frac{461+t}{528}.$$

From the foregoing it is evident that the theoretical
 velocity and volume of the hot gas discharged from the
 chimney are proportional to *the square root of the
 height of the chimney ; to the square root of the head
 or excess of pressure of the outside air over that of the
 hot gas in the chimney ; or to the square root of the
 increase of temperature of the hot gas.*

An error made by some writers on this subject is in
 assuming that because $V = \frac{D}{d} v$ the draught force
 increases in proportion to the increase in velocity or
 inversely as the increase in density of the heated gases.
 But as the motive force, or force that produces the
 draught, is proportional to the height of the head,
 and the velocity due to this head is proportional
 to the square root of its height or to $\sqrt{H_1}$, and

as this height is proportional to the ratio of the densities, or to $\frac{D-d}{D}$ we have the velocity proportionate to $\sqrt{\frac{D-d}{D}}$ and not to $\frac{D}{d}$.

The actual velocity of the entering cold air and hot gases is reduced below the theoretical velocity by the resistance to their passage offered by the contracted areas through the fire-grate and layer of fuel, and over the bridge, by the bends and change of direction in the flues, by the change of shape and area of flues which cause eddies in the current, and by the friction against the sides of the flues and chimney.

Let $\frac{1}{K}$ express the relation of these various resistances to the velocity of the hot gases, then we shall have

$$V = \frac{1}{K} \sqrt{2 G H_1 \times \frac{D}{d}}.$$

According to Peclet's researches the actual velocity is given approximately by the following formula.

$$V = 8 \left(\frac{461+t}{523} \right) \sqrt{\frac{H}{1+G+\left(\frac{f'l}{4}+N\right)(1+at)^2}}$$

here l = the whole length of chimney and flues, in feet ;

f' = a co-efficient of friction which Peclet found to be 0.012 for the passage of furnace gases over sooty surfaces ;

d = diameter of round, or side of square flues ;

G = a factor of resistance for the passage of air through the grate and the layer of fuel above it, which may be taken at 40 for ordinary Boiler furnaces.

N---number of bends at right angles to direction of current.

Morin, who has wrongly, as we consider, assumed the velocity of the hot gas to vary as $\sqrt{\frac{D-d}{d}}$ instead of $\sqrt{\frac{D-d}{D}} \times \frac{D}{d}$, gives the following method of investigating the forms of resistance theoretically, the co-efficients being our own:—It is evident that the moving force P, which tends to make the air enter the chimney is expressed by

$$P = (D - d) A H$$

A being the area of the chimney as before. If the mean velocity of the current in the chimney be V, the work developed per second by the motive pressure will be

$$(D - d) A H V.$$

The resistance of the sides to the movement of the gases will be represented by the expression

$$\frac{d S L \beta V^2}{g}.$$

S being the perimeter, or contour of the flues or chimney; L, the length of the chimney and flues, being equal to H when vertical; β , a co-efficient for any given kind of internal surface of flues and chimney.

The work developed per second by this resistance will be

$$\frac{d S L \beta V^3}{g}.$$

If $M = \frac{W}{g}$ the mass of the gases, whose weight $W = d A V$, the *vis viva* imparted to this mass by the difference of pressures or motive force P will be

$$M V^2$$

Now this *vis viva* is usually diminished in at least six different modes:—

1. By the contraction at the entrance of the ash-pit. Now, supposing this entrance to be equal in area to the flues, the loss of *vis viva* may be expressed by

$$M \left(\frac{1}{m} - 1 \right)^2 V^2$$

m being the co-efficient of contraction at entrance. This loss of *vis viva* may be neglected when the orifice of entrance is such that m differs very little from unity; but this is seldom the case. The co-efficient m of contraction is usually taken from 0.60 to 0.80. Taking it at 0.70, we have

$$\left(\frac{1}{.70} - 1 \right)^2 = \left(\frac{1}{.70} - 1 \right)^2 = .185.$$

The total *vis viva* given to the gases in motion, and which consists of that maintained in the chimney and of that lost at the entrance, will be expressed by

$$M \left(+ \left(\frac{1}{m} - 1 \right)^2 \right) V^2$$

2. If the area of the entrance orifice has a section different from and less than that of the flues or chimney, the loss of *vis viva* will be $M (V' - V)^2 = M V^2 \left(\frac{A}{m' A'} - 1 \right)^2$, V' being the velocity through the orifice whose area is A' .

The term $\left(\frac{A}{m' A'} - 1 \right)^2$ may acquire a considerable value when all the air has to pass through the bars and bed of fuel and over the bridge. The area for the passage of air being frequently only $\frac{1}{16}$ the area of the

section A of the chimney (or less when a thick layer of caking coal is used), in this case

$$\frac{A}{m' A'} = 10$$

and

$$\left(\frac{A}{m' A'} - 1 \right)^2 = 81.$$

When the area for the passage of air through the fuel equals the space between the fire bars or commonly $\frac{1}{2}$ the section of chimney outlet, then

$$\frac{A}{m' A'} = 2$$

and

$$\left(\frac{A}{m' A'} - 1 \right)^2 = 1.$$

This formula is, strictly speaking, only applicable where the density of the fluid does not change in its passage.

3. A loss of *vis viva* takes place at every elbow or bend. With a single flush-flued externally fired boiler there may be only a single elbow, namely at the bottom of the chimney; but in tubular boilers set in the best manner and connected with a single chimney there are often as many as eight elbows. Taking this number, and expressing the loss at each bend by $M \left(\frac{1}{m''} - 1 \right)^2 V^2$ we have to repeat the term $\left(\frac{1}{m} - 1 \right)^2$ eight times. Supposing $m'' = 0.70$, we have

$$8 \left(\frac{1}{m''} - 1 \right)^2 = 8 \left(\frac{1}{.70} - 1 \right)^2 = 1.48.$$

A similar loss occurs where two or more currents meet us in a split draught, uniting again in a single flue.

4. Then we have the loss of each enlargement of the

flue represented by $M \left(1 - \frac{A}{O} \right)^2 V^2$. This nearly always occurs at the bridge, at the entrance of the flues into the chimney, and where a number of tubes deliver into a large space or flue. The greatest value this term can have is in the case where the area O of the enlarged section is so large in proportion to that A of the small flue, or tube, that we may regard $\frac{A}{O} = 0$. Then

$$\left(1 - \frac{A}{O} \right)^2 = 1.$$

Supposing $\frac{A}{O} = \frac{1}{2}$ then

$$\left(1 - \frac{A}{O} \right)^2 = 0.25.$$

5. When the area A_1 of the exit orifice of the chimney is less than the area A , the velocity will be V_1 instead of V making the co-efficient of contraction m_1 the volume of the gases discharged will be

$$m_1 A_1 V_1 = A V,$$

whence $V_1 = \frac{A}{m_1 A_1} V.$

when $m_1 A_1$ is less than A_1 the velocity V will be greater than V_1 , which will give a greater steadiness of draught but diminish the volume discharged per second. Taking the velocity of exit orifice to that of mean velocity as 3 to 2, we have $V_1 = \frac{3}{2} V = 1.5 V,$

$$\text{whence } \left(\frac{A}{m_1 A_1} \right)^2 = 2.25.$$

In tapered boiler chimneys the area A is usually taken as that of the outlet, and in such cases the *vis*

viva becomes $M V_1^2$ instead of $M V^2$, and is not the average velocity of the draught in the chimney.

6. The resistance arising from the friction of the air or gases over the sooty surface of the flues and chimney will be represented by $\frac{2 S L \beta}{A}$ as already given.

In a circular or square chimney we have $\frac{S}{A} = \frac{4}{D}$
this term then becomes

$$\frac{8 L \beta}{D}$$

The value of the co-efficient β depends upon the number and shape of tubes, flues and passages through which the gases flow, and is given by Peclet as 0.012 for sooty surfaces.

The proportion $\frac{L}{D}$ varies very much, taking it at 100 and 30 respectively, the term $\frac{8 L \beta}{D}$ becomes

$$8 \times 100 \times 0.012 = 9.6.$$

$$8 \times 30 \times 0.012 = 2.880.$$

Collecting these terms we have:—

1st term	$\left(\frac{1}{m} - 1\right)^2$	=	1.85	1.85.
2nd	„ $\left(\frac{A}{m' A'} - 1\right)^2$	=	1	81
3rd	„ $\left(\frac{1}{m''} - 1\right)^2 \times 8$	=	1.48	1.48.
4th	„ $\left(1 - \frac{A}{\theta}\right)^2$	=	.25	.25.
5th	„ $\left(\frac{A}{m_1 A_1}\right)^2$	=	2.25	2.25.
6th	„ $\frac{2 S L \beta}{A}$	=	2.88	9.64.
			<hr/> 9.71	<hr/> 96.47.

When all these causes of loss of *vis viva*, or motive

force, are present in the same draught the principle of *vis viva* applied to this circulation will give us the following relation:—

$$M V_1^2 + M \left(\frac{1}{m} - 1 \right)^2 V^2 + M \left(\frac{A}{m' A'} - 1 \right)^2 V^2 + M \left(\frac{1}{m''} - 1 \right)^2 V^2 + M \left(1 - \frac{A}{\theta} \right)^2 V = 2(D-d) A H V - \frac{2 d S L \beta V^3}{g}.$$

In this general equation, the mass of air which passes each section in one second is the same, and in the expression of its value

$$M = \frac{d A V}{g}$$

whence

$$\frac{d V}{g} = \frac{M}{A}.$$

Also according to the notation already employed

$$V_1 = \frac{A}{m_1 A_1} V$$

dividing both sides of the general equation by

$$M = \frac{d A V}{g}$$

we have the following,

$$V^2 \left\{ \left(\frac{A}{m_1 A_1} \right)^2 + \left(\frac{1}{m} - 1 \right)^2 + \left(\frac{A}{m' A'} - 1 \right)^2 + \left(\frac{1}{m''} - 1 \right)^2 + \left(1 - \frac{A}{\theta} \right)^2 + \frac{2 S L \beta}{A} \right\} = 2 g \left(\frac{D-d}{d} \right) H = 2 g \frac{a(t - T) H}{1 + a T}$$

whence

$$V = \sqrt{\frac{2 g \left(\frac{D-d}{d} \right) H}{\left(\frac{A}{m_1 A_1} \right)^2 + \left(\frac{1}{m} - 1 \right)^2 + \left(\frac{A}{m' A'} - 1 \right)^2 + \left(\frac{1}{m''} - 1 \right)^2 + \left(1 - \frac{A}{\theta} \right)^2 + \frac{2 S L \beta}{A}}}$$

or

$$V = \sqrt{\frac{2g \frac{a(t-T)H}{1+aT}}{\left(\frac{A}{m_1 A_1}\right)^2 + \left(\frac{1}{m} - 1\right)^2 + \left(\frac{A}{m' A'} - 1\right)^2 + \left(\frac{1}{m''} - 1\right)^2 + \left(1 - \frac{A}{0}\right)^2 + \frac{2SL\beta}{A.}}$$

Substituting for the denominator in this equation the values found for each term we have for the first

$$V = \sqrt{\frac{2g\left(\frac{D-d}{d}\right)H}{9.71}} = 0.3 \sqrt{2g\left(\frac{D-d}{d}\right)H};$$

and for the second value,

$$V = 0.102 \sqrt{2g\left(\frac{D-d}{d}\right)H}.$$

From the results of observation and experience it may be safely considered that the velocity as a rule lies between those given by using the two co-efficients 0.1 and 0.3. For ordinary practice, where there are not many very small tubes or very restricted passages over the bridge and elsewhere, and where the fire is not very thick and solid the co-efficient 0.3 may be used. Then

$$V = .3 \sqrt{2g\left(\frac{D-d}{d}\right)H}$$

$$V = 2.4 \sqrt{\frac{D-d}{d}H}.$$

In practice with a strong draught $\sqrt{\frac{D-d}{d}}$ differs very slightly from unity and may be left out, whence we have

$$V = 2.4 \sqrt{H}.$$

In using the correct formula $V \sqrt{\frac{D-d}{D}} H \times \frac{D}{d}$ we should have found that for the conditions of density, &c., usually found with boiler chimneys that $\sqrt{\frac{D-d}{D}} \times \frac{D}{d}$ is usually about 1.4 where $\sqrt{\frac{D-d}{d}} = 1$, whence we should have $V = 1.7 \sqrt{\frac{D-d}{D}} \times \frac{D}{d}$.

Where the length of the horizontal flues is great compared with that of the chimney and their diameter small, the velocity will be somewhat diminished.

With respect to the expression

$$\frac{D-d}{d} = a \left(\frac{t-T}{1+aT} \right)$$

Morin states that Peclet, in his "Traité de la Chaleur," 3rd ed., (p. 37, vol. i.) has admitted

$$\frac{D-d}{d} = a \frac{(t-T)}{1+at}$$

an error which in many cases may materially alter the results, since the temperature T of the atmosphere scarcely ever varies more in this country than from 10° to 80° , making the denominator $1+aT$, vary from 1.02 to 1.16, whilst the other denominator, $1+at$, would vary from 1.2 to 2.3, and lead to very material mistakes. This, however, does not apply practically to boiler chimney draughts.

In the above mode of investigating the motive force of the draught it would have been more correct to have taken the *vis viva* of the cold air entering the ash-pit and fire-bars at the velocity due to its density, and to have made allowance for the change in the density as the air passed through the fire. It may be here re-

marked that theoretical and scientific refinements are unnecessary and often worse than useless in seeking to determine the actual velocity of the draught of any given chimney, when the circumstances and conditions are so complex and uncertain in actual practice that no theoretical formulæ can be expected to give results even approximately correct under all circumstances and conditions of working, which are continually varying. It is needless to seek to determine the exact pressures or densities at the top and bottom of the chimney in order to arrive at the average pressure and density at a given barometrical pressure when this pressure varies from day to day. The direction of the wind has a very decided effect upon the draught; when it blows strongly into the ash-pit and furnace it may greatly increase, and when it blows from the ash-pit it may greatly lessen, the motive force of the preponderating column of cold air. Then the shape of the chimney top, hygrometric condition of the atmosphere, presence of blow-holes or leakages in brickwork, angle or inclination to each other of bends at converging flues and points of uniting of split draughts, partial choking up of air passages and flues by clinkers, soot, and flue dirt, change in the quality of fuel, and many other uncertain circumstances likely to influence the force of the draught, are more important than smoothness of brickwork and any accurate determination of mean temperatures and densities. It is, however, well to know that uncertain conditions do exist, in order that we may know pretty nearly how far we may be guided by any rules we may find or establish for our own use.

In examining the general equation (pp. 7 and 13) we gather from the numerator with certainty :—

1st. That the velocity of the air and gases is proportionate to the square root of the height of the chimney, so that by doubling the height the theoretical velocity is increased only in the proportion of $\sqrt{1}$ to $\sqrt{2}$, or as 1 to 1.4, and in seeking to increase the draught by altering the height of the chimney we must quadruple the height in order to double the force of the draught, assuming that the area remains the same and that the additional height causes no more friction, which is, however, not the case, as the increase of height increases the value of the last terms in the denominator, in the equation in p. 7. In practice there is a limit to the height for the best draught, beyond which the additional height increases the resistance due to the increased velocity and friction more rapidly than the flow of cold air. For chimneys not over 3' 6" diam. at top this maximum height appears to be about 300ft.

2nd. That the velocity of the flow of cold air is proportionate to the square root of the ratio $\frac{D-d}{D}$.

On examining this expression we find that the draught does not increase so quickly as the square root of the difference in temperature between the hot gases and the outside air, and that very little is gained theoretically by increasing the temperature of the gases in the chimney, when the ratio of the densities of the outside air and the hot gas are as 2 to 1. By raising the temperature from 600° to 1200° we should theoretically only increase the draught force in the proportion of .71 to .86, and in practice it would be still less.

On the other hand, when we place an economiser in

the flue and seek to reduce the temperature of the escaping gases from say 650° to 350° , we should diminish the velocity of the draught only in the proportion of $\sqrt{.75}$ to $\sqrt{.61}$, or as 1 is to 0.8.

3rd. From the denominator we gather that the velocity is inversely proportionate to the square root of a denominator in which at least six uncertain elements may combine to make its value equal to from 9 to 100, and, as the co-efficient of reduction depends in each case upon given conditions, the particular values should be introduced into the denominator.

The loss from these causes may be obviated

- a*, by facilitating the entrance of the air into the ash-pit and through the fire-bars and body of fuel, which may be done by making the dimensions of the passages as large as practicable, and making their shape as favourable as possible for the passage of air.
- b*, by avoiding as much as possible contractions, elbows, sudden bends, and alterations in the direction of the flow of air. Where contractions necessarily occur, there should be no corners left, but the contraction should be approached gradually by tapering the flue.
- c*, by avoiding as much as possible all enlargements, and especially sudden enlargements, in the flues, which cause eddies in the current of gases. Here again the flue should be tapered.
- d*, by making the surface of the masonry as smooth as possible.
- e*, by having no holes in the brickwork for the cold air to enter. Defects in the brickwork between two parts of a flue, by allowing the hot

gases to make a shorter circuit to the chimney, will improve the draught at a sacrifice of economy, as the defective brickwork beneath the boiler practically reduces the extent of heating surface.

In estimating the volume of the gases of combustion, we can take the volume of the mixed carbonic acid, nitrogen, and unburnt oxygen, in the chimney, as equal to the original volume of air, and the density is increased simply in the ratio of the sum of the weights of the air and of the carbon taken up, to the weight of air. The volume of the mixed steam, nitrogen, and unburnt oxygen, is greater than the original volume of air by an amount equal to the quantity of oxygen that has combined with hydrogen, but the quantity of hydrogen in ordinary fuel bears so small a proportion to the total weight of fuel that it is not worth considering, and the volume of the gases in the chimney may be taken as equal to the volume of air at the given temperature.

Then the variation of density produced by the deviation of pressure from the mean atmospheric pressure may be disregarded.

The volume of the gas at 62° and at one atmosphere may be taken as being sufficiently near for all practical purposes at 13 cubic feet for each lb. of air supplied to the furnace.

It has been shown in the author's "Treatise on Steam Boilers," p. 254, that a larger quantity of air than the theoretical amount for combustion passes the furnace, and the following are approximately the quantities of air required under different circumstances.

	Vol. of air at 62° per lb. of fuel.
12 lbs. per lb. of fuel	= 158
18 " "	= 236
21 " "	= 275
24 " "	= 306

The volume Q at any other temperature, t , may be found by the formula.

$$Q = Q_1 \frac{(461 + t)}{523}$$

Q_1 being the volume at 62°.

SUPPLY OF AIR IN LBS. PER LB. OF FUEL.

	12	18	21	24
Temperature.	Volume of gases per lb. of fuel in cubic feet.			
32°	148	222	259	297
62°	158	236	275	316
75°	162	242	282	324
98°	169	252	294	338
212°	204	304	355	408
300°	230	343	400	460
400°	260	388	452	520
500°	290	433	505	580
600°	320	480	558	640
700°	350	524	610	700
800°	380	570	663	760
1200°	500	748	871	1002
2000°	742	1109	1292	1485
2500°	894	1336	1556	1789
3000°	1044	1569	1818	2089
4000°	1346	2011	2343	2692

Let W = the weight in lb of fuel burnt *per second*.

Q_1 = volume at 62° of air supplied per lb. of fuel (see table).

A = sectional area of chimney in square feet.

Then V the velocity per second of the current in the chimney will be

$$V = \frac{W Q (461 \cdot 2 + t)}{A \times 523}$$

$$W = \frac{V A \times 523}{Q (461 + t)}$$

From this the weight of fuel per hour that can be burnt in the furnace can be calculated when we have found the velocity, V , by formula

$$V = 2 \cdot 4 \sqrt{H}$$

The density, d , of the current in lb. per cubic feet is approximately

$$d = \frac{523}{461 + t} \cdot 0.0761 + \frac{1}{Q};$$

$$\text{that is, from } 0.079 \left(\frac{523}{461 + t} \right) \text{ to } 0.082 \left(\frac{523}{461 + t} \right).$$

The head, H , expressed in feet, of a column of the outside air, may be converted into P_1 , an equivalent pressure in lbs. per square foot thus—

$$P_1 = H_1 D = H_1 \times 0.0761,$$

the temperature of the atmosphere being taken at 62° .

The unit of head most commonly employed is an inch of water, when syphon water gauges graduated into inches and decimals are used to measure the difference of pressure within and without the shaft. As a cubic foot of water at 62° weighs 62.355 lbs., a column of water one inch high must exert a pressure of 5.2 lbs. per square foot of surface, whence we have

$$\frac{1}{5.2} = 0.192 \text{ for a multiplier, and Head in inches of water} = 0.192 P_1 = H_0$$

$$H_0 = 0.192 H_1 \times 0.0761$$

and

$$H_1 = \frac{\text{Head in inches of water}}{0.192 \times 0.0761};$$

from which formula we can calculate the height of chimney to give any required head, expressed in inches of water, when the temperature inside and outside

are known :—Since $(p. 4) H = \frac{H_1}{t_1}$ we have

$$32.3 \times t_1$$

$$H = \frac{\text{Head in inches of water} \times 523 \times t_1}{0.192 \times 0.0761 \times t_1}$$

Suppose we want a chimney sufficiently high to give a head of $\frac{3}{4}$ inch of water, with the temperature inside at 523° above the temperature of the atmosphere we have then

$$H = \frac{.75}{.192 \times .0761} \times \frac{1}{\frac{t^2}{523 \times t_1}} = 103 \text{ feet.}$$

In the expression in Morin's formula for V the velocity of the air which passes up the chimney, it is obvious that this quantity increases indefinitely with the temperature T in the chimney, and it might appear that any increase in the temperature of the hot air would be attended with advantage for increasing the draught. It is not, however, the volume of air, or gases discharged by the chimney that it is desirable to increase, but rather that of the air passing through the grate. Now if we call this volume of the outside air Q_1 , and its density D , the weight of air passing through the bars being equal to the weight of that discharged by the chimney, less the amount due to the weight of fuel burnt we have the relation

$$d Q = D Q_1,$$

whence

$$Q_1 = \frac{d Q}{D} = .95 \frac{1 + \alpha T}{1 + \alpha t} Q = .95 \frac{461 + T}{461 + t} Q.$$

Consequently Morin's formula for the volume Q at the temperature t would take the form

$$\begin{aligned} Q_1 &= \frac{d}{D} A \sqrt{2 G H \frac{t - T}{461 + T}} \cdot .95 \\ &= A \sqrt{2 G H (461 + T)} \sqrt{.9 \frac{t - T}{(461 + t)^2}} \end{aligned}$$

It is evident from this last form that whilst the weight of air to be discharged increases inversely as the temperature, the draught-force increases as the square root of the temperature, hence the weight of air Q_1 at the

temperature T has a maximum value corresponding to a certain temperature t of the gas which is discharged from the chimney, and which should not be exceeded. This is found from the factor

$$\sqrt{\frac{-T}{(461+t)^2}}$$

which expression attains a maximum when

$$t = \frac{461 + 2T}{.9}.$$

Therefore according to this theory of draught of Morin the best chimney draught takes place when the absolute temperature of the hot gas in the chimney is to that of the external air as $2\frac{1}{7}$ to 1 approximately, or when the head in hot gas $h = H$; that is, when the density of the hot gas is about one-half that of the external air. When the external temperature $T = 62^\circ$ we have for the temperature within the chimney $\frac{461 \times 124}{.9} = 650$.

Although this result would be modified by taking into account the resistance to the flow of the gases in the long flue between a boiler furnace and the chimney, yet according to this theory, the temperature within any chimney to ensure the best draught should not much exceed 600° , and this limit is completely independent of any disparity in area of flues and chimney, and it is somewhat remarkable that the mean temperature of good boiler chimneys agrees pretty closely with this maximum temperature.

The proper allowance of air for a good chimney draught being about 21lbs. per lb. of fuel, the volume at 62° is about 275 cubic feet per lb. of fuel, and the

volume of the hot gas at 600° about 558 cubic feet per lb. of fuel, or 27 cubic feet per lb. of the hot gas itself.

With respect to the head and temperature of the hot gas for the most effective draught, Rankine arrives at a similar result to the above as follows:—the velocity of the gas in the chimney is proportional to \sqrt{h} , and therefore to $\sqrt{0.96\{461+t-(461+T)\}}$. The density of that gas is proportional to $\frac{1}{461+t}$.

The weight discharged per second is proportional to velocity \times density, and, therefore, to

$$\frac{\sqrt{0.96\{461+t-(461+T)\}}}{461+t}; \text{ which expression becomes}$$

a maximum, when

$$461+t = \frac{2(461+T)}{.96} = 2\frac{1}{12}(461+T);$$

therefore the best chimney-draught takes place when the absolute temperature of the gas in the chimney is to that of the external air as 25 to 12.

Morin, in his "*Étude sur la Ventilation*," treats the hot air in the chimney as not having passed through the fire-bars, which is correct for some modes of ventilation, but not for boiler chimney-draught. He consequently gets the result equivalent to $t = 461 + 2T$, and remarks that Péclet, in the second edition of his *Treatise*, undertook an investigation for the temperature corresponding to the maximum of the volume of air drawn in by the chimney, and he arrived at the result just given, but the formulæ, which in the third edition of the same work are substituted for those in the second, being inaccurate, led him to suppress the investigation and its consequences, of which there is no longer question, in the third edition.

In what appears to be the correct theory of draught, where $V = \sqrt{2 G H \left(\frac{t-T}{1+at} \right) \times \frac{461+t}{523}}$, there is no such theoretical maximum temperature for the best draught, as above found by Rankine and Morin, since the velocity and volume of the flow of air increase continually with the increase of temperature t . According to the above expression, based on this theory, as the temperature increases, $\frac{a(t-T)}{1+at}$ approaches nearer and nearer to unity, and if we take the temperature $t = 200$ to $t = \infty$, we shall have the velocity of the cold air varying in the ratio of .44 to 1, or as 1 to 2.3. As we have already seen at p. 17, when the density of the hot gas is about half that of the density of the outside air, or about 600° , the velocity has .71 of the theoretical maximum. In practice, however, as the velocity and volume of the gases discharged increase with the rise of temperature, the resistance due to friction increases very rapidly also, and there is a maximum efficiency of draught which is not given by the formula. For boiler furnaces there is no practical gain in the draught, but a great waste of fuel by increasing the temperature of the escaping gases much beyond 600° .

In formula (p. 20) we had

$$W = \frac{V A \times 523}{Q (461 + t)},$$

whence

$$A = \frac{W Q (461 + t)}{V 523},$$

taking the temperature of the discharged gases as 600° and 21 lbs. of air, per lbs. of fuel burnt $\frac{Q (461 + t)}{523}$ becomes 5.58, and

$$A = \frac{W \times 558}{2.4 \sqrt{H}}.$$

W is here the weight of coal burnt per second, but taking w as the weight burnt per hour, we have

$$A = \frac{w \times 0.07}{\sqrt{H}}.$$

$$w = \frac{A \sqrt{H}}{0.07}$$

$$H = \left(\frac{w \times 0.07}{A} \right)^2$$

from which we have the column in the table for the area of a chimney to burn a given quantity of coal when the height is given in feet. The area in feet here is taken as that for the top opening of the chimney, and a conical or pyramidal chimney may be treated as though it were cylindrical or parallel. This agrees very nearly with the formulæ commonly given for land chimneys, and answers very well for a single boiler chimney, giving about $2\frac{3}{4}$ square feet for a Lancashire boiler consuming 10 tons of coal per week of 60 hours with a shaft 90 feet high.

Ninety feet is a very common height for boiler chimneys in large towns, being the minimum height allowed by many Town Improvement Acts, as in Manchester, Leeds, and other towns.

When, however, a number of boilers have only one chimney in common, the area does not require to be so large as the sum of several chimneys used for single boilers, since the friction becomes reduced, and the draught is greatly steadied when several boilers are fired successively, and a higher temperature is maintained.

The flues should be made larger than the area of the chimney, as they become contracted when soot and flue dirt gathers.

A common rule arrived at from experience is to make the flues and area of the chimney top equal to from $\frac{1}{8}$ th to $\frac{1}{10}$ th the area of firegrate without taking into account the height of the chimney. Another useful rule is to allow from 2 to 3 square feet for each boiler, having about 30 square feet of firegrate, the former allowance answering for chimneys over 150 feet high, which discharge the gases from several furnaces working together, and the latter for chimneys under 150 feet high, with not over six furnaces. There are many tall chimneys—over 200 feet—answering well with only from $1\frac{1}{4}$ feet to $1\frac{3}{4}$ feet square of top opening for every 30 square feet of firegrate where more than half-a-dozen boilers are working together with one chimney in common. It may be taken for granted that ordinary chimneys cannot be too high for obtaining a good draught.

It is usually considered that the larger the area of the chimney the better the draught, but this is not always the case with lofty chimneys where the gases can *cool down too rapidly* in a chimney of large section, and it has been found in several instances that when chimneys are very large for the number of boilers they serve, or for the quantity of coal burnt, as when a chimney is built to serve for future additions to the boiler power, the draught is improved by the better maintenance of temperature as additional boilers are set to work. When the area of the chimney is much larger than the aggregate area of the flues debouching into it, the diminution of friction and the expansion of the hot gases into a large area are favourable for the improvement of the draught. But the velocity of the ascent of the heated gases may be very much diminished, and in extreme cases, where the ascending current does not

fill the chimney, so to speak, downward currents of air will be produced, especially with the wind in certain directions, to the impairment of the draught.

The effect of this may be seen in the lazy ascent of smoke from such chimneys, which are usually blackened at the top, and for some distance downwards. In a strong wind the smoke may be seen clinging to the leeward side of the chimney.

On the other hand, if the section be too small in proportion to the aggregate section of flues and fire-grate, the loss of force will be considerable, and can only be slightly increased by increasing the temperature of the escaping gases, which, as a rule, will be adverse to economical fuel consumption.

In practice it is found that with a lower pressure than half an inch of water it is difficult to keep a good fire without continual stirring, which is very wasteful, and produces smoke.

There can be no doubt that in still weather the height of the column of hot gas exceeds that of the chimney when the current of gases ascends beyond the summit, and with certain winds, when the shape of chimney top is favourable, the current of air will tend in many cases to increase the draught beyond that measured by the height of chimney. On the other hand, the shape of chimney-top may be such that the draft may be diminished in high winds, unless the wind blows direct into the ash-pit.

It is also known by experience that with certain states of the atmosphere, although the water-gauge may show a good draught, the fires do not burn briskly, in spite of the quantity of air with which they are supplied. The air appears to be comparatively dead when it blows,

especially in the summer, and when it has prevailed from the south. It is not easy to account for this. The direction of the wind is not always a guide, nor indeed can it be expected to be, since it blows in whirls, and may be a south wind in one part of the island and a north wind in another part; yet it is certainly not a characteristic north wind that is found to affect the fires adversely.

The temperature of the escaping gases is usually ascertained by attaching small pieces of the following metals about 1" long and $\frac{1}{4}$ inch square to a wire, and introducing them at any desired point in the flues or chimney, the time required to melt them being noted. The melting point of zinc is 700° Fahr.; of lead, 630° ; bismuth, 493° ; and of tin, 426° . When introduced into the flue behind the damper of Cornish and Lancashire boilers of moderate draught, it has been found that tin melts almost immediately, bismuth in about a minute; lead melts after a short time when the fires are clear, but zinc does not melt under any circumstances. It may therefore be assumed that 600° , or about the melting point of lead, is the average temperature of the escaping gases when the boilers are at work. This shows that the loss of heat is very considerable, and it may be approximately calculated as follows:—Taking the quantity of air used as about 21 lbs. per lb. of fuel, we have (see p. 253 of "Treatise") the weight of the products of combustion of 1 lb. of coal multiplied by the specific heat of the mixed gases = 3.053 , and the remaining 9 lbs. of air multiplied by its specific heat $.238 = 2.142$. Adding these two products together, we have 5.195 , and multiplying 293° , or the elevation of the temperature of the gases above the

IISc Lib B'lore

621.183 M99



3907

3907

boiler at 60 lbs. pressure, we have 15320 units of heat, equivalent to 1.5 lbs. of water evaporated per lb. of

taking the total heat of combustion at 2750°

loss is equal to 10 per cent. compared with the heat that would be obtained if the hot gases escaped at the temperature of the boiler.

In the table facing the title-page the sizes of chimneys and flues required for various consumptions of fuel and sizes of boilers are given. In the second column we have the number of lbs. of coal per hour for the consumption of which a chimney of given height and area is suitable. Suppose we have two boilers, each having 35 sq. ft. of grate area, burning 12 lbs. of coal per sq. foot of grate per hour, equal to 840 lbs. of coal per hour, then, by column 2 a chimney 90 feet high should have the area at smallest part about $840 \div 135 = 6$ sq. feet, that is, about 2 ft. 6 in. square, or 2 ft. 9 in. diam. In columns 4, 5, 6 and 7 the horse-power of different areas of chimney, and the areas for different horse-powers are given. The somewhat meaningless term, horse-power, as usually applied to chimneys, is here reluctantly adopted in deference to the practice which still appears likely to survive a long time in this country, of estimating the capability of boilers by their horse-power.

CHAPTER II.

STABILITY OF CHIMNEYS.

WHEN the proper height and size of chimney have been decided upon to ensure a sufficient draught for the furnace, and also to satisfy the sanitary requirements of the case, the designing with respect to ornamentation, beauty of outline, and harmonising with surrounding buildings, belongs to the architect rather than to the engineer; but the design, so far as the stability of the structure is concerned, still lies within the engineer's province. The principles of stability have been laid down by Professor Rankine, who, up to the time of his death, was regarded as the first authority on this subject.

In estimating the safety and stability of a tall chimney shaft, the strains to be considered are—1st, the pressure exerted by the weight of the masonry or brickwork; and 2nd, the lateral pressure of the wind.

In order to resist the former strain, the best form of structure is that which gives an equal pressure per square unit of area in every section or "bed-joint." Taking, for simplicity, a solid cylinder, the weight evidently increases from the top downwards. This increase of weight must therefore be provided for by an increase in the sectional area as we descend. But this very increase of area augments the rapidity of growth of the mass as we descend, and the sectional area below must be further increased in consequence. For a structure whose centre of figure is the same as

its centre of pressure, this law of increase may be deduced with the aid of the differential calculus as follows :—

Let W = weight of top layer of chimney,

A = area of top section,

k = coefficient of safety (for brick say 10 tons per square foot),

c = weight of cubic foot of brickwork,

a = any given section at distance h from the top,

e = basis of natural logs = 2.71828 ;

then $W = A k$ or $A = \frac{W}{k}$, which gives us the first sectional area from the top to resist crushing. Any other section can be found by the formula

$$a = A e^{\frac{c}{k} h}.$$

$$\text{or } \log a = \log A + 0.4343 \frac{c}{k} h.$$

This formula applies also to hollow cylinders or cones having a straight batter inside.

It is evident from this formula that the outline of the structure will be a logarithmic line, practically straight at the top, and increasing in concavity as it approaches the bottom, giving what is called a "hollow batter." For ordinary chimneys 100 ft. high the amount of concavity required is not worth considering. For tall shafts, 300 ft. high and over, it is sometimes used. There is, however, this great advantage in using a straight batter instead of the theoretically correct hollow batter; viz., the accuracy of the construction can be detected at any stage at a glance of the eye without the aid of instruments. Yet it must be conceded that

the hollow batter is much more shapely, and may be worth the extra expense of building.

In a chimney made of blocks of stone or brick separated by plain joints, where there is no lateral pressure, the conditions of stability are—1st, that no joint shall be inclined to the horizon at a greater angle than that of repose, which in this case may be taken at $36\frac{1}{2}^{\circ}$; and 2nd, that in any given bed-joint the centre of downward pressure, or point which is vertically below the centre of gravity of the superincumbent mass, shall not depart from the centre of figure of the joint more than a certain distance, which for round chimneys may be taken at $\frac{1}{4}$ the diameter of the joint, and for square chimneys $\frac{1}{3}$ the length of the joint.

In order to be able to calculate the strains caused by the lateral pressure of the wind, we must first consider the manner in which the chimney will fail by this pressure.

If the joints between the blocks of the material composing the structure had any tenacity such as the riveted or bolted joints of wrought or cast-iron, or of brick or stone held together by wrought-iron cramps, or by cement of a strength equal to that of the material it joins, the structure should be considered as one piece, and its strength determined by an investigation based on the theory of the strength of materials. But chimneys are usually made of brick or stone, the blocks of which, laid in mortar, touch each other at their joints, which are flat surfaces, held together by pressure and friction, but *not by tension*, so long as the mortar is fresh, and on this basis the stability ought to be considered. Even a year after mixture, the strength of good mortar is only about 50 lbs. per square inch, and

a large proportion of failures of chimneys have occurred before the mortar has had time to set, which shows that the strength of the mortar should never be taken into account in designing a new chimney; but for old chimneys the strength of the mortar may also be considered, and taken at 8000 lbs. per square foot when not less than eighteen months old. In cases where chimneys have been sawn to restore them to the perpendicular, and the joints have not been properly remade with mortar or cement, the weight of the chimney can alone be depended upon for its stability.

In designing a new chimney, we may then disregard the tenacity of the mortar, and consider the chimney as being simply set upon its foundation and held down only by its own weight, upon which alone it is dependent for its stability. The moment of stability for a new chimney at any point is evidently half the diameter of the bed-joint, B_1 , at this point, \times the weight, W , of the chimney above this joint, or $W \times \frac{B}{2}$.


For an old chimney, if we make the solid area in square feet at the joint $= B_1$, we have the moment of stability $= (W + B_1 \times 8000) \frac{B}{2}$.

The lateral pressure of the wind may be assumed to act horizontally, and to be of uniform intensity at all heights above the ground. The greatest intensity in this country, against a flat surface directly opposed to it, used to be taken by Rankine at 55 lbs. per square foot, but in 1868 the pressure of the wind at Liverpool was registered at nearly 80 lbs. per square foot, the highest ever known in this country. For new chimneys the pressure of the wind may still be taken at 55 lbs.

The inclination of the surfaces due to the batter or slope of the chimney is usually not sufficient to be taken into account in estimating the pressure of the wind against it.

A circular chimney may be considered as cylindrical in plan, and the total effect of the pressure against the side of a cylinder may be taken as being equal to one-half the total pressure against its diametral plan, or against the side of a square chimney of equal diameter,

which for the strongest winds gives us 40 lbs. per square foot. This result is arrived at thus: Let $AB = p$, the force of the wind (in fig. 2) in a direction parallel to the diameter, XY , of the chimney. Resolving AB into its component parts at right angles, and with one of

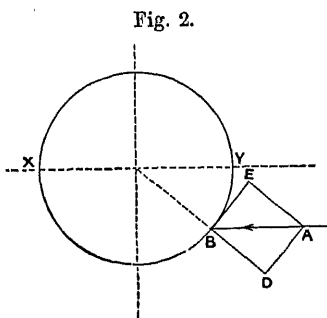


them, BD , as a normal to the curve at the point B , we have BD as the measure of force exerting pressure towards the centre of the chimney, and $BD = p \sin \angle ABD$. We have now to resolve this force again to get the component as measuring the effective pressure in a direction parallel with that of the wind, whence we have $p \sin^2 \angle ABD$. Taking a number of points affected by the wind, the mean sine of the arcs will be about $\cdot 75$. The square of $\cdot 75 = \cdot 56$, whence the mean effective pressure on the semicircumference $= p \cdot 56$.

If the pressure on a square chimney be taken	=	1
that on an Hexagonal chimney may be taken	=	0.75
„ Octagonal „ „	=	0.65
„ Circular „ „	=	0.5

Let S = the area in square feet of the vertical section through the middle of the portion of the chimney above the base or joint BC (fig. 3), then for a square chimney the total pressure P against the side $= pS$, and for a round and octagonal chimney $P = p\frac{S}{2}$. The resultant of this

pressure may be considered to act in a horizontal line

Fig. 3.

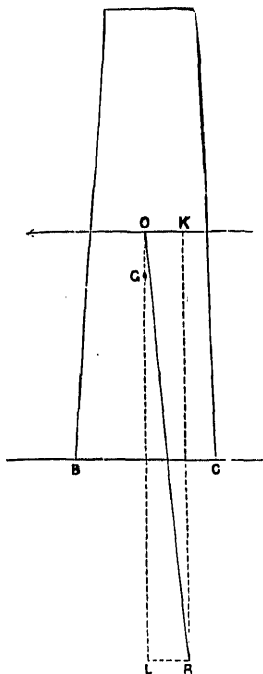

through O , the centre of gravity of the vertical diametral section. This centre of gravity may be found thus: let $ABCD$ in fig. 4 represent the vertical section of a chimney or division of a chimney. Draw the diagonals BC and AD . On CB mark off $CE = OB$, and bisect AD in F . Join EF , then the point where EF cuts the centre line of the figure is the centre of gravity. Let H = the height of this centre O above the joint BC in fig. 3, then the moment of pressure is $HP = H pS$ for a square chimney, and $HP = \frac{H p S}{2}$

for a round or octagonal chimney, and to this moment of pressure "the least

moment of stability" of the portion of the chimney above the joint or base BC should be equal.

A balance of moments will exist when $HP = W\frac{B}{2}$, in


the case of a new chimney, or $HP = (W + B_1 \times 8000) \frac{B}{2}$ for an old chimney. To ensure stability, it is evident the moment of stability must exceed the overturning moment. In practice a factor of safety of 2 is sufficient to use, whence we have $HP \times 2 = W \frac{B}{2}$, or $(W + B_1 \times 8000) \frac{B}{2}$.

It is advisable to describe these forces graphically, as in fig. 3. Draw the vertical line OGL through the centre of gravity G of the chimney, or of the division above the joint in question, as may be required. Let O be the centre of pressure against the side. Set off OK equal to P and $OL = W$. Complete the parallelogram, and join OR then when the line OR crosses the base or joint BC at a distance of $\frac{1}{4}$ of BC from the centre OL , the chimney is sufficiently stable to prevent overturning.

It may be considered that the lines of resistance in a square and circular shaft of the same height are very nearly identical in shape and position when the diameter and sides of the square are respectively equal. This is in consequence of the round chimney, although containing less material, being subject to less pressure.

The manner in which a chimney yields to the pressure of the wind is, however, by the opening or cracking of one of the bed joints at the windward side, without completely overturning. This opening gradu-

Fig. 4.

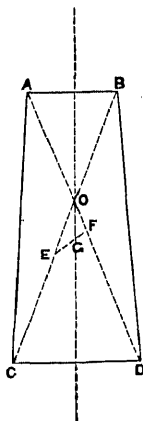

BOILER AND FACTORY CHIMNEYS.

extends, in a more or less regular zig-zag course finally downwards towards the lee side. The complete destruction eventually takes place, either by the shifting of the upper portion past its support, or by the crushing of the brick-work at the lee end, by the too great pressure concentrated there, or in many cases, from both causes acting together, and in some cases the upper portion of the chimney falls to the ground inside and out, filling the interior of the portion remaining standing.

The resistance to the horizontal shifting of a bed of masonry is due to the friction of the horizontal faces of the blocks of stone or brick, and is called "frictional resistance," whose amount at any given joint is the proportion of the vertical load on the joint into the coefficient of friction, which for masonry and brick-work with lamp mortar, is about 0·74.

The tendency of the wind pressure being to open the joint at the windward side, and to crush the masonry at the leeward side, or to overturn the structure above the joint in a plane parallel with the direction of the wind, it is evident that the centre of resistance of the structure will be moved towards the leeward side.


It has been found by experience necessary to limit the deviation of the centre of resistance from the centre of gravity, so that the maximum intensity of pressure on the leeward edge shall not exceed twice the mean intensity. Denoting by q the ratio which the distance of the centre of resistance bears to the diameter of the joint j , we have

For round chimneys $q = \frac{1}{4}$ the dia. of the joint.

For square " $q = \frac{1}{4}$ " "

The moment of stability of a chimney at any given bed joint is the product of the weight of the structure, or of the weight of the structure plus the tenacity of the mortar as the case may be, above that joint into the horizontal distance qj . If the axis of the chimney be vertical, as in fig. 3, the limiting distance qj , for the centre of pressure will be the same in all directions. But most chimneys are found to have their axes not quite vertical, and the least

Fig. 5.

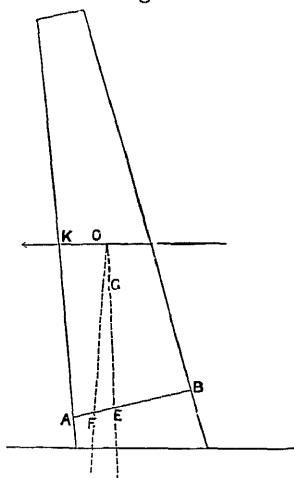

moment of stability is evidently that which resists the pressure in that direction towards which the axis of the chimney leans. In estimating the stability of existing chimneys this must be taken into account. In figure 5 let G be the centre of gravity of the structure above the joint $AB = j$, and let E be a point in the joint vertically below it, and let $q'j =$ the distance of the point E from the middle of the joint j , then the least moment of stability is denoted by $W \times EF = (q - q') Wj$, F being the limiting position of the centre of resistance of the joint, all dimensions being in feet, and p being taken at 55 lbs. for new chimneys.

Then for round chimneys.

$$\frac{h p S}{2} - \left(\frac{1}{4} - q' \right) W j.$$

and for square chimneys

$$h p S = \left(\frac{1}{3} - q' \right) W j.$$

BOILER AND FACTORY CHIMNEYS.

these equations the following are deduced for

Let t = mean thickness of brickwork above
 B C, w = the weight of 1 cubic foot of brick-
 12 lbs. as a rule, d = mean outside diameter
 y, then we have approximately—

for round chimneys, $W = 3.14 \text{ wt. } \left(\frac{d-t}{d}\right) S.$

for square chimneys, $W = 4 \text{ wt. } \left(\frac{d-t}{d}\right) S.$

ing these values in the equations just given,
 the following formula which will be found

nd chimneys, $H p = (1.57 - 6.28 q') \text{ wt. } \left(\frac{d-t}{d}\right) j.$

are chimneys, $H p = \left(\frac{4}{3} - 4 q'\right) \text{ wt. } \left(\frac{d-t}{d}\right) j.$

we require to know the mean thickness of
 for a new chinney, the form and dimensions
 en, we have the following tentative formulæ,

s being multiplied by $\frac{d}{d-t}$ for the actual

when t is so found.

$$t = \frac{H p}{1.57 w j} \text{ for round chimneys.}$$

$$t = \frac{H p}{\frac{4}{3} w j} \text{ for square chimneys.}$$

side diameter of the chimney at the ground
 l not, as a rule, be less than $\frac{1}{10}$ th the height.
 r varies from 1 in 60 to 1 in 10 : 1 in 24 is
 non.

ney shaft is made up of a series of steps or
 ne above the other. Each step is of uni-
 ness, but as we ascend, each succeeding step

is t
 bed
 cha
 join
 nece
 stre
 T
 ness
 prac
 diffe
 In
 bric
 weig
 115
 app
 mal
 ness
 the
 the
 opp
 itse
 in h
 insi
 chin
 fron
 in c
 25
 leng
 bric
 200
 90
 *
 90 t
 stru

is thinner than that which it rests upon, so that the bed joints between the steps, where the thickness changes, have less stability than the intermediate bed joints, and it is only these former to which it is necessary to apply the formulæ in determining the strength and stability of the structure.

The height of the different steps of uniform thickness varies greatly according to the judgment and practice of the architect or builder, and the custom in different districts.

If we take the safe load that can be borne by good brickwork, at 20,000 lbs. per square* foot, and the weight of brickwork with little mortar at the joints at 115 lbs. per cubic foot, we have $20,000 \div 115 = 170$, approximately, as the extreme height in feet, we should make any single division, or length, of uniform thickness. This length is very seldom approached even in the tallest shafts, as the brickwork has also to bear the weight due to force of wind acting against the opposite side of chimney, in addition to the chimney itself. The steps, or courses, should not exceed 90 feet in height, except in cases where the chimney shaft is inside a tower which protects it from the wind. In chimneys from 90 to 120 ft. high, the lengths vary from 17 to 25 ft., the top height being 1 brick thick; in chimneys from 130 to 150 ft., the lengths are from 25 to 35 ft.; in chimneys from 150 to 200 ft. the lengths are from 35 to 50 ft. the top length being $1\frac{1}{2}$ brick thick, and in very tall chimneys, that is, from 200 to 300 ft., and over, the lengths vary from 50 to 90 ft., the thickness of top length being $1\frac{1}{2}$ bricks.

* As the crushing strength of ordinary brickwork is much less than 90 tons to the square foot, the strength of the bricks used in very high structures should be ascertained by experiment.

The binding of the masonry* is often increased by laying at intervals hoop-irons, tarred and sanded, in the bed joints, the ends being turned down into the side joints. The length of the hoop-iron in each joint, should be twice the circumference of the chimney at that part.

Forge chimneys are often strengthened by strong bands of wrought iron, placed at intervals outside; but these are not necessary for boiler chimneys. Sometimes strong hoops about $3'' \times \frac{1}{2}''$ are built in at intervals of 12 to 18 feet, to prevent cracks, but unless the chimney is provided with a very efficient lighting conductor, these masses of iron are apt to prove dangerous during a thunder-storm.

It is usual, and expedient, to protect the inside of the chimney with a lining of fire brick. For forge and ironworks' chimneys, where the gases escape at a very high temperature, the lining should be carried all the height. If care be taken to heat the chimney gradually for the first time of working, and subsequently, when it has been allowed to become cold, it is not necessary to have an air space between the fire-brick lining and the shaft proper. In this case the lining may be included in the thickness of brickwork necessary for the strength and stability of the shaft. The firebrick lining may then be bonded into the other brickwork in the ordinary way, the thickness of the lining being $\frac{1}{2}$ brick in the upper portion, and 1 brick in the lower portion, and should be laid in fire clay, and not in mortar like the other brickwork.

* The bond usually adopted is 1 course of headers to 4 of stretchers. In circular chimneys a uniform bond for the outside course of brickwork is sometimes less frequently adopted.

In boiler chimneys it is, however, unnecessary to carry the lining all the way to the top. In small chimneys, under 100 feet high, it may be carried one-third, or one-half the way up, and in chimneys of great height, the lining need not be carried higher than from 50 to 80 feet, according to the height of the chimney shaft.

An arrangement often used, is to carry the lining up parallel, that is, without taper, and to let the outside shaft meet it at a very acute angle. This leaves an air space between the lining and the main body of the shaft, which should be provided with air holes, communicating with the external atmosphere, but carefully sealed from communication with the inside. This caution is necessary, because when the gases that pass through the flues have access to the air space round the lining, there is always a risk of damage being done by the explosion of inflammable mixtures of gas and air that may collect. It is, therefore, advisable, when an air space is provided, not to allow any communication between it and the inside flue, consequently the plan of leaving the air space open to flue at top, so often done, cannot be recommended.

It is, however, perhaps, best to dispense with the air space altogether, as the difference between the temperature of the portions of the chimney above and below the top of the air space, renders the masonry liable to fracture at this part, and many chimneys may be found so fractured without the actual cause being suspected.

In erecting a chimney, care should be taken that the building is not proceeded with too rapidly. It is sometimes restricted to a rate not exceeding 6 feet a

day in height. It is advisable to build chimneys when the work can be most steadily proceeded with. When the structure is built up too rapidly, and the mortar has not time to set, a gale of wind is liable to press the chimney over to one side, where it stays—the compressible nature of the mortar offering little or no resistance. Consequently, the less mortar used the better. Cement, owing to its crumbling when exposed to a high temperature, cannot be recommended except for the top of the chimney, where it may, however, be usefully employed. Grouting should, as a rule, not be attempted.

In order to gain admission into flues and chimneys, many engineers and architects make doors in the sides or crown of the horizontal flues leading to the chimney. A much better plan, however, is to make an arched opening at the bottom of the chimney, or in the pedestal, at one side of, or opposite the flue entrance. This opening can be readily built up air tight. Such a provision in the chimney may be required for introducing a fire of wood and shavings, to cause the boiler fire to draw on first lighting up, after the flues have been allowed to become cold and damp, especially when they descend to the chimney. This opening would be of service when it is advisable to make experiments on the draught, which are too often overlooked, but which may be of great service in detecting a falling off in the draught, and lead to the detection of air leakages, and other defects that may operate strongly against the economical or efficient working of the boilers.

With respect to the best position for the dampers for regulating the draught, apart from all consideration of

economy and efficiency, it is most convenient to have them at the end of the external flues of the boilers, or between the boiler and the chimney. The dampers are therefore generally so placed, but this is the least advantageous position for preserving the temperature in the flues and chimney, and the energy of the draught, which would be best preserved at meal-times and over night, by placing the damper on the top of the chimney. Here, however, it would not keep the flues under the boiler so warm as when placed in its usual position behind the boiler, and the effect would be felt in lighting up on Monday mornings.

Dampers at the ashpit might be used with some advantage in maintaining the temperature of the boiler flues.

The depth and area of the foundation will depend very much upon the nature of the ground upon which the chimney is built. In many cases where chimneys are built on the banks of a river, and other places where the upper strata are of alluvial clays, soft silts and made ground, it is necessary to go to a depth of 25 or 30 feet, or even more, to reach a good stiff clay, hard sand or rock. This depth below the surface is excavated and filled in with concrete in various ways, or piled, according to the practice of the locality, or judgment of the engineer, so as to economise material without risking unequal settling of the structure, which cannot be too carefully guarded against, as it has often led to the failure of the chimney.

CHAPTER III.

DESCRIPTIONS OF CHIMNEYS.

THE following account of some of the largest brick and stone chimneys that have been built may be of interest. The highest chimney is at Mr. Townshend's Works, Port Dundas, Glasgow; and it is, with the exception of the spire at Strasburg, the Great Pyramid, and the spire of St. Stephen's at Vienna, the loftiest building in the world. It is circular in section, and rises to a height of 454 feet from the ground. The foundations are laid 14 feet below the surface on a bed of stiff clay, mixed with pebbles, and consist first of six courses of hard brick on edge, covering a circular area of 47 feet in diameter, diminished by outward "scarce-ments" to a diameter of 44 ft. Over this solid substratum the foundation proper consists of twenty-six courses of brick also on edge, diminished by scarcements on both sides from 21' 9" to 8' 6" thick. At the surface the outside diameter is 32 ft., with walls 5' 3" thick ($6\frac{1}{2}$ bricks). There is an inside lining of firebrick carried up 50 feet, with an air space round it. At the cope the outside diameter is 12' 8", with 14 inch walls, the total height of the building being 468 feet. The thickness diminishes by half a brick every step. There are six steps; the first of 40 ft., then four of 80 ft., the top step being 94 ft. The outside batter is straight from bottom to top. The point of least stability is at top of second step from the ground.

In Glasgow there is also the celebrated chimney at the works of Messrs. Tennant and Co., St. Rollox. From the base of foundation to the top of chimney it measures $455\frac{1}{2}$ feet. The section above ground consists of five steps,—54, 60, 96, 140 and 85 ft. in height. Commencing from the ground the thickness of wall at ground is four bricks; and diminishing half a brick at each step, being two bricks thick at top. The outside diameter at ground level is 40 feet, and at summit 13' 6". The point of least stability is at top of third step. The foundation is 50 feet square, and 20 feet deep. The inner chimney is a cylinder 16 feet diam., and 260 ft. high. It is not connected with the outer one, but nearly touches it at the top. The weight of the chimney is estimated to be about 7,000 tons.

In Halifax, at Messrs. Crossley's, Dean Clough Mills, there is a large octagonal chimney of stone. Its height when built was 381 feet, but some of the top was removed on account of the immense weight at the foundation. The width at the bottom is 30 ft. Nearly 10,000 tons of brick and stone were used in the erection, being considerably more than the weight of Messrs. Townshend's chimney in Glasgow.

The tall brick chimney at the Edinburgh Gas Works is $341\frac{1}{2}$ feet from the bottom of the foundation. The shaft is circular, 264 feet high, and built in steps of 35, 40, 48, 58 and 83 ft., commencing from the base, which is $3\frac{1}{2}$ bricks thick, the highest being $1\frac{1}{2}$ bricks. The inside diameter of shaft is 20 ft. at base, and 11' 4" at top. The foundation and pedestal, which are square, are of stone, $77\frac{1}{2}$ ft. high. The cost was nearly £5,000.

At Huddersfield there is a tall circular chimney at Messrs. Brooks's Fireclay Works. It measures from

the foundation 321 ft., and rises 306 ft. clear above the ground. The base at the foundation is 36 ft. square. At the ground line it is 31 ft. and at the summit 11 ft. diameter. The flue is 14 ft. diam. at the bottom and 9 ft. at the top.

In Bradford, at Messrs. Mitchell Bros.' factory, there is an octagonal stone chimney, that rises 300 feet above the ground. The foundations consist of two courses of concrete 22 ft. and 21 ft. square by 12 inches thick each, resting upon the rock. It measures 20 ft. across at the foundation and 9 ft. at the summit.

At the West Cumberland Hæmatite Iron Works, there is a circular brick chimney, designed by Prof. Rankine, 251 feet above the ground, with 17 ft. foundation below. Inside diameter of basement is 18 ft. 10 in. Inside diameter of the four circular archways for flues, 7 ft. 6 in. Outside diameter at top of cone, 15 ft. 3 in., and $1\frac{1}{2}$ brick thick; outside diam. at 2 ft. above bottom, 25 ft. 7 in.; outside diam. of square basement, 30 ft. \times 30 ft.; outside dimensions of foundation course, 31 ft. 6 in.; outside dimensions of concrete, 34 ft. 6 in. sq. There are three steps, the two uppermost being 80 ft. each, whilst the bottom one is 88 ft. high. At summit the thickness is $1\frac{1}{2}$ brick; at bottom of lowest step, 2 ft. above the ground, $2\frac{1}{2}$ bricks, increasing by courses four bricks in order to spread the pressure. The cost was £1,560.

The well known chimney of the Shell Foundry at Woolwich Arsenal is 223 ft. 9 in. above the ground, with 16 ft. of brickwork below, making 239 ft. 9 in. above the bed of concrete. The base above the ground is 20 ft. square, with plinth and cornice, 27 ft. high, on which the octagonal shaft is erected. It is 16 ft. 9 in.

diam. at base, and 6 ft. 6 in. at top. The walls are 2 ft. $7\frac{1}{2}$ in. thick at bottom of shaft, and are reduced by steps of $37\frac{1}{2}$ ft. $4\frac{1}{2}$ in., the top step of 26 ft. being 9 in. thick. The uppermost 9 ft. is bell-mouthed, and built in cement. The Portland stone cap weighs about 17 tons.

Perhaps the tallest *square* chimney in this country is that at the Camperdown Linen Works, near Dundee. This chimney, or rather tower, rises 282 feet from the ground. It is somewhat in the Italian style, and is built of variegated brick. At the summit of the tower, which is 230 ft. high, constructed in panels, there is a balcony, above which the shaft is octagonal. The thickness of the walls at the ground is 5 ft., at the balcony 2 ft. 6 in., and at the top 18 inches. This tower is quite distinct from the chimney proper, which is circular in form, 14 ft. 6 in. diam. at base, and 13 ft. 3 in. at top. Its thickness is 18 in. from ground to first panel; 14 in. from this to the balcony, and 9 in. from balcony to summit. The tower is 24 ft. 6 in. sq. at the ground, and 20 ft. sq. at the balcony, above which it tapers gradually to the summit. The weight is about 5,000 tons, and the cost is said to have been about £6,000.

At Messrs. Lister's, Manningham Mills, Bradford, there is a lofty square chimney, 249 ft. high, with panelled sides, and circular top. The inside of the square at ground is 10 ft., gradually increasing to 11 ft.

At Connah's Quay, Chester, there is another lofty square chimney, 245 feet high from the ground. The size inside is 17 ft. 6 in. at base, and 7 ft. at top. Its cost is said to have been but little over £2,000.

Besides the circular, octagonal, and square forms

generally used, there are a few peculiar shapes sometimes met with.

With a view to get a parallel flue from bottom to top without using an inside shaft, the walls of a square chimney may be carried up in one thickness about 150 ft. high, and 14 inches thick. In order to obtain stability two buttresses are run up at each side, tapering to nothing at the summit. There is a chimney of this kind at the South Metropolitan Gas Works.

Some chimneys have been built, having a section like an eight-pointed star, the inside being octagonal or circular, with or without inside lining, or air space.

Iron chimneys are seldom used except for small boilers, and are usually of small dimensions, and made circular. A few, however, have been erected within the last ten years of considerable dimensions. There are two at the Creusot Works in France. One is 197 ft. high, 4 ft. 3 in. dia. at top, and 10 ft. at bottom. It is constructed with a hollow batter, and is firmly bolted to masonry work just clear of the ground. It was riveted together horizontally, and lifted into its place with a crane. The thickness of the plates is $\frac{3}{8}$ in. at top, and $\frac{7}{8}$ in. at bottom. Its weight is 28 tons.

There is a still larger chimney at Creusot, of which a description will be found in "Engineering," vol. xiii. It is 279 feet high, 7 ft. 6½ in. dia. at the top, 22 ft. 11½ in. at the bottom, and weighs 80 tons. It is built also with a hollow batter, and is held by bolts and a strong angle-iron ring, to a mass of masonry weighing about 300 tons. Its cost was about £1,600.

The experience in such chimneys is not yet sufficient to enable us to judge with any degree of certainty of their durability. It is, however, certain that with some

kinds of fuel, in spite of careful painting and partial lining with brickwork, their destruction will be very rapid, and the adoption of iron chimneys can only be recommended where the cost of brick and stone precludes their adoption.

A brick or stone chimney, substantially built, and with a fair margin of stability, will last many generations, whilst an iron chimney of moderate thickness cannot be depended upon, in many cases, to last more than forty or fifty years.

THE SHAPE OF CHIMNEY TOPS.

Although the position and surroundings of the furnaces, with respect to the direction of the wind, have a very decided influence upon the draught, and may outweigh any small advantage that one chimney top may have over another, yet it must be admitted that the shape of the top has a perceptible influence in promoting or retarding the draught when a strong wind is blowing.

Some chimneys, which are not excessively wide, have a better draught in all high winds, which may be accounted for by the arrangement of the boiler-house, its surroundings producing a greater pressure of air at the furnaces when a gale is blowing. In some arrangements a gale from a certain quarter may have an exhausting action, tending to draw the air from the furnaces, whilst a gale from the opposite quarter tends to increase the pressure at the furnaces, and so improves the draught.

With a plain or "bluff" top, a strong wind may act partially as a damper, as may sometimes be seen by the action it has upon the column of smoke as it issues

from the chimney. The wind not only flattens the escaping column, but it also tends to produce downward eddies, especially in very large chimneys. There is often evidence of the downward eddies on the outside in the blackened appearance of the masonry on the lee side of the chimney. But as the wind, striking against a bluff top tends to rise vertically in the first place, and clear the windward side of the chimney at a short distance above it, this shape is decidedly better than that of some of the tops so often seen, which are concave at the rim and convex at the orifice, and appear to be designed to guide the wind right into the chimney and check the draught. A better shape for an open top is concave towards the orifice, so as to give the wind an upward direction, whereby the tendency will be rather to promote than check the draught.

When there is both an inner and outer shaft, the design for deflecting the current of air upwards can be carried out to the greatest advantage. The top of the inner shaft should be stopped off a few feet below that of the outside shaft and surmounted by a concave deflecting cap, from which the currents of air admitted through suitable openings in the outer shaft are deflected upwards and not only prevent any downward eddying, but tend to induce an exhausting action in the inner shaft, and consequently to promote the draught. At the same time the top of the outside chimney should be surmounted with a concave deflecting cap.

It appears strange that in the endless variety of designs for chimney caps, in the case of a single shaft, advantage has never or very seldom been taken of the opportunity to make the cap hollow, and in such a manner as to cause an induced current upwards on the

same principle as that just mentioned for a double shaft.

Some very shapely chimney caps are made concave below and convex above; were they made concave both above and below they would have the best form for splitting the current of wind, and so prevent it from interfering with the draught.

Covered tops of a pyramidal shape, having vertical, tapered openings at the corners, have been used with decided advantage. By this arrangement the wind can blow into only one or at most two of the openings at once, leaving the others free to discharge fully. The sum of the areas of the openings should in this case be considered as the size of the orifice of the chimney. When practicable, the openings should be so arranged that when the wind is blowing from the chimney to the furnaces, it does not tend to blow down any of the openings, or, in other words, one side of the top should face the furnaces when these are behind the chimney.

The cost of chimneys varies within very wide limits. A few years ago chimneys up to 90 feet high could be built in the Midland Counties in a certain style for £1 per foot, but a more usual cost is from £2 to £2 10s. per foot, for chimneys up to 100 feet high. As much as £22 a foot has been paid for some of the ornamental tall towers with inside shafts.

CHAPTER IV.

CHIMNEYS—LIGHTNING CONDUCTORS.

THERE are many engineers at the present time who argue that lightning conductors are useless, or even worse than useless ; hence the number of tall chimneys seen unprovided with lightning rods in various parts of the country.

The destructive effects of lightning are much more frequent and ruinous than is generally supposed. Whilst some twenty cases could be quoted where lightning has fallen on unprotected powder magazines, and caused their explosion, killing thousands of people, and laying whole towns in ruins, it may be questioned whether a single case can be cited of a powder magazine being struck, that was properly protected by a lightning conductor.

The causes of the widespread disbelief in conductors as a means of preserving chimneys and other lofty buildings against the destructive action of lightning, are :—

1. The opinion commonly held, and often where we should least expect to find it, viz., that metallic bodies, especially when pointed, *attract* lightning, and are therefore dangerous. This opinion is probably due to the fact that during thunderstorms luminous points have often been seen on spires, vanes, ship's masts, and other elevated metallic bodies. The glowing appearance here spoken of is unattended by any heating effects, and is harmless.

This phenomenon, like some other spheric electricity, is due to the highly electrical condition of the clouds and atmosphere, at once concluded that these bodies have a superior attractive force for electricity over all others. Now metallic bodies, whether pointed or not, have no more power of *attracting or drawing* the lightning to them than non-metallic bodies, and it is the confusing of the apparent with the actual attractive force, or erroneously concluding that metals are good attracters because they are good conductors, that has brought about the misunderstanding on this point. Now in no case can it be said that the conductor attracts the lightning in the active and adverse sense which is here implied, and in which this term is often used. On the other hand, the conductor acts, especially when its top is pointed, in preventing the prominence to which it is applied from becoming highly electrified *by induction*, and in so much actually prevents the structure from attracting the cloud that electrifies it. On an electrified cloud passing over a pointed conductor, the opposite and induced electricity of the earth is discharged from the point of the conductor, and the cloud and air are often thereby neutralised without producing lightning at all. But when a discharge does take place the duty of the conductor is entirely passive: by offering a line of comparatively small resistance, it determines the direction of the discharge, which is not, however, in the first place brought about by the presence of the conductor, or, what more often happens, the presence of the uninsulated pointed conductor, by its peculiar property, prepares the resisting air in such a manner that the current of electricity is discharged quietly and without violence or a flash of

lightning. Should, however, the electrified clouds be driven to the erection by the winds in such masses that the opposite kind of electricity does not stream away from the point of the conductor in sufficient quantities to prevent a spark from passing, the spark, or flash of lightning, will pass from the cloud to the conductor in preference to any neighbouring point, since the electric density will be greater here, and the resistance least. Hence the duty of the conductor may be considered as being entirely passive, as, by offering a line of comparatively small resistance, it determines the direction of the discharge when it becomes inevitable, although it is not brought about by the presence of the conductor in the first place, but by the action of the clouds and a large area of ground. To use an oft repeated simile, the conductor no more attracts the lightning than a water-spout, on the side of a house, attracts the rain from the clouds which it leads to the drain in the ground.

The fact that so many well-known buildings, which were repeatedly struck by lightning before being furnished with rods, have escaped being struck after the lightning rods were applied, would appear to be conclusive evidence of the passive character of the pointed conductor with respect to the discharge, and that its presence averts a violent explosion by rapidly neutralising the electrical condition of the atmosphere.

The luminous appearance, accompanied by a whizzing noise, sometimes observed when a very dense discharge is received by the conductor, is of a perfectly harmless character, and is probably of the same nature as the "glow" discharge, so well known to those who have made and witnessed electrical experiments.

2. The disbelief in the efficacy of lightning conductors is sometimes due to the carelessly expressed opinions of many writers on electricity, to the effect that thoroughly efficient lightning conductors might discharge the electricity *gradually* and harmlessly into the ground, but would be a poor protection to the building in the event of its being struck by a flash. Now, in answer to this, there are many cases on record of ships and buildings having been struck by lightning. Those provided with efficient conductors have borne the shock unharmed, whilst those unprotected have suffered severely. Perhaps the most convincing evidence of the efficiency of good lightning conductors is that adduced by Sir W. S. Harris from the journals of H. M. ships. In 1861, he writes, "We had between the years 1810 and 1815, that is, within about five years, no less than 40 sail of the line, 20 frigates and 12 sloops and corvettes, placed *hors de combat* by lightning. In 250 such cases, 100 seamen were killed and 250, at least, severely hurt. In the merchant navy, within a comparatively small number of years, no less than 34 ships, most of them large vessels, with valuable cargoes, have been totally destroyed, being either burnt or sunk, to say nothing of a host of vessels partially destroyed or severely damaged. Damage to H. M.'s ships by lightning has happily ceased (since effective conductors were applied); it is now not known in the British navy." Damage to ships by lightning seldom occurs now, as most ships are fitted with wire ropes, which act as lightning conductors.

3. A more reasonable objection, at first sight, to the use of conductors, is that many buildings have been damaged in spite of the presence of lightning rods,

and when it is assumed that a conductor acts by attracting the lightning, which would not take place but for the conductor's presence, the doubt at once arises whether the amount of security afforded by the rod really outweighs the danger provoked by its supposed active influence in attracting and bringing down a large flash of lightning. In all cases, where the matter has been properly investigated, it has been found that the conductors have been ignorantly and wrongly applied. Either the continuity of the conductor between its termination and the earth has been broken by the presence of rust at the joints, or by the iron connections under ground rusting away; by the rod itself being broken; or by the too common careless or ignorant mode of not bringing the end of the conductor properly to earth. It is the opinion of many that if the rod is merely buried a foot or two in the ground it is all that is required. We shall presently see this is by no means sufficient.

4. There is an opinion widely spread, and due in a great measure to the use of the terms "thunderbolt" and "electric fluid," by many writers on electricity, that a small rod of copper, from $\frac{1}{2}$ inch to 1 inch diameter, is totally inadequate to carry off such a large quantity of "fluid" sufficiently rapidly and safely as is supposed to exist when a large flash of lightning is observed.

5. Many persons point to buildings, such as the dome of St. Paul's cathedral, as not being provided with any external special conductor, yet which have escaped being struck in very severe storms. In most of these cases, by the arrangement of the materials of which it is constructed, the building itself is a first-rate conductor, in some cases for a certain height only and in

others from the summit to the ground. St. Paul's is now fitted with copper rope conductors.

In applying a lightning conductor to a chimney or other similar structure, the principles to be kept in view are—

1. To use the best available material; that is, which acts best as a conductor of electricity, and resists corrosion. This material is copper.

2. To provide an adequate sectional area to lead the electricity harmlessly away. This is best arrived at by experience. Harris, in 1861, after citing a number of cases of terrific tropical thunderstorms, concludes that a copper rod $\frac{3}{4}$ in. diameter, or an equal quantity of copper under any other form, would resist the heating effect of any discharge of lightning which has yet come within the experience of mankind. Faraday considered a $\frac{1}{2}$ in. copper rod sufficient, but of course approved of using $\frac{5}{8}$ or $\frac{3}{4}$ in. rods when the expense was not too great.

3. It should be made in such a manner as to run the least risk of having its continuity interrupted in the event of its being fractured. With this object in view, rope is better than rods, since it can be made in the first place in one continuous length, whereby the risk of badly formed joints is avoided; it can be readily coiled and carried to its destination without being cut; and, in the event of being roughly used, the breakage of one or more strands does not destroy the efficiency of the remainder. When joints are used they should be formed by screwing the ends right and left-handed, and bringing them in close contact by a screwed copper socket of ample strength.

The conductor should be supported or suspended in

such a manner as not to risk its fracture by settlement of the structure or disturbance of one or more of its supports or guides.

4. The upper extremity should project above the top of the chimney to a distance, say, equal to the diameter of the chimney top, and should terminate in a brush of three or four points arranged round the central terminal, and curved to project therefrom at an angle of about 45° .

5. As a rule the rod should be placed inside the structure in the case of a monument, where it is less liable to be damaged, and is in a better general position for protecting the building, besides being out of sight. But for a chimney the rod should always be outside, as the gases from some coals are liable to corrode copper and iron rapidly wherever they come in contact with these metals, especially in the presence of moisture.

6 To prevent lateral discharge the conductor should be in communication with all hoops or pieces of metal round the chimney, and the use of all insulated pieces of metal, especially arranged parallel to the conductor, should be avoided.

7. The rod should terminate in the ground in two or more branches, which should be carried into a well, and terminate in a large copper plate, or be connected with a water drain (made of metal, and not fireclay), or pump, water or gas pipes, or any other good conducting channel. Where this is not practicable, the several branches should be carried into earth that is permanently moist, and end in a cast-iron case filled with coke, or cinders; or have a large copper plate terminal; or where no moist earth exists permanently the branches under-

ground should have plenty of length, say 30 feet or more, according to the nature of the ground and size of rod. If no earth-plate is used, the wires of the copper rope should be unstranded and spread out.

When placed outside the chimney the rod may be brought down in contact with the stone or brick-work, and no insulating means are required. A flash of lightning has sufficient intensity to break through miles of air in some cases, hence an attempt at insulation a few inches or even feet in length can have no practical effect in preventing it from striking the brick-work in case the rod should prove insufficient to carry it safely away.

The earth terminal of the rod—unlike the rod itself—should expose as much surface to the soil as possible, because this surface is the measure of the section of solid earth employed to carry off the discharge. Many authorities have advocated the use of a ball instead of a point at the top of the rod, the former being considered best for attracting the lightning from the building; a point is, however, far better for drawing off the electricity, as it does so quietly, and without sparks, and would commence its neutralising effect long before a ball would act, and by so doing might be the means of preventing a violent discharge altogether. In considering the advantages claimed for the ball top, it must not be forgotten that in comparison with the vast area of most electrified thunder clouds, the largest ball, the use of which could be contemplated, must be, after all, a mere point. Although many cases of fusion of copper points are recorded, this material should be still used in preference to iron for the points of conductors, although iron has a higher point of fusion.

All combinations of copper and iron in contact should be avoided, especially when the smaller part of the combination is of iron, to avoid the rapid destruction of the iron by galvanic action, which is but too likely to occur; for instance, iron nails, spikes, staples, &c., should not be brought in contact with the copper rod to support it.



Notwithstanding that water or gas pipes of iron, placed a few feet from a conductor where it reaches the ground, have been broken by the lightning springing to them from the conductor, it yet appears to be the safest plan to connect the conductor with such pipes. In some cases the breakage has been doubtless due to explosion of the steam formed by the intense heat of the lightning current on meeting with the comparatively greater resistance of the ground between the conductor and the pipes. Where there is no resistance offered to the passage of the current no heat or violent effect will ensue.

In a previous paragraph we have spoken of the importance of terminating the rod in "good earth." Upon this depends the value of the lightning rod. Most of the accidents which have taken place—where conductors have been on the building—can be accounted for by insufficient earth connection. A lightning rod when fixed should be tested by a galvanometer, and the "earth" should be tested at least once a year.

A very portable galvanometer for testing lightning conductors has recently been introduced by Mr. Richard Anderson, M.S.T.E., F.C.S., of 101, Leadenhall Street, London.

The following woodcut shows the arrangement of the battery, galvanometer, and resistance


coils. The battery consists of three cells, and is a modification of the old manganese cell, in which the carbon and oxide of manganese occupy the outer

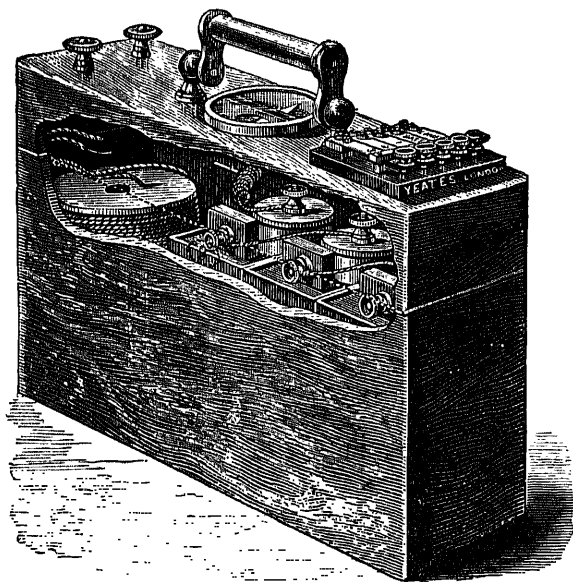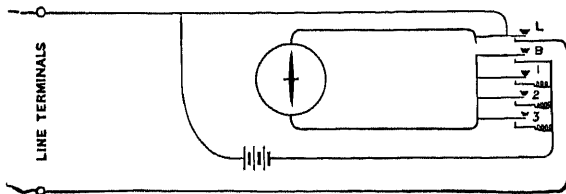

and the zinc plate the inner or porous cell. By this arrangement (introduced a few years ago by Mr. H. Yeates, of Covent Garden), the surface of the negative element is greatly increased, and hence a more constant

current is obtained, on account of the battery not polarising so rapidly as in the old form. Another advantage of this arrangement is that the cells can be almost entirely sealed up, the air openings being made within the porous cell. In the centre of the lid of the box is placed the galvanometer with a "tangent" scale. On the left are two terminals by which to connect the conductor to be examined. On the right-hand end of the lid are placed five keys, marked respectively, L, B, 1, 2, 3. Under B is one pole of the battery, so that by depressing this key, as will be seen by following the connections in the diagram, the battery current is sent through the galvanometer direct. If, however, we depress key No. 1, we connect the battery with the galvanometer through a known resistance. Key No. 2 has a larger resistance, and No. 3 still larger. The fifth key, L, closes the circuit within the limit of the instrument, but on being depressed opens it and includes the line or conductor placed between the two terminals at the other end. On pressing down L and B, it will be seen that the resistance of the line or conductor may be compared with the known resistance connected with any of the keys Nos. 1, 2, 3, or any of these resistances may be included with that of the line, so as to get a convenient deflection of the galvanometer needle.

In the case with the battery is a bobbin of insulated wire for connecting the instrument with the conductor and earth to be tested.

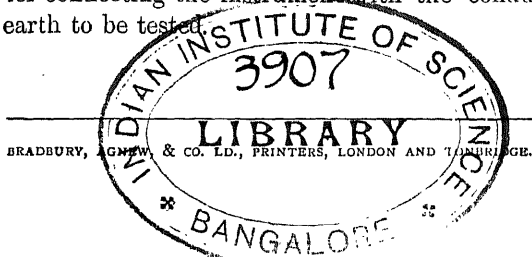

CROSBY LOCKWOOD & SON'S

LIST OF WORKS

ON

CIVIL, MECHANICAL, MARINE AND ELECTRICAL ENGINEERING.

A Complete Catalogue of NEW and STANDARD WORKS on MINING and COLLIERY WORKING; ARCHITECTURE and BUILDING; The INDUSTRIAL ARTS, TRADES and MANUFACTURES; CHEMISTRY and CHEMICAL MANUFACTURES; AGRICULTURE, FARMING, GARDENING, AUCTIONEERING, LAND AGENCY, &c. Post Free on Application.

7, STATIONERS' HALL COURT, LONDON, E.C.

1907.

LIST OF WORKS

ON

CIVIL, MECHANICAL, ELECTRICAL
AND MARINE ENGINEERING.

AËRIAL NAVIGATION. A Practical Handbook on the Construction of Dirigible Balloons, Aërostats, Aëroplanes, and Aëromotors. By **FREDERICK WALKER, C.E.**, Associate Member of the Aeronautic Institute. With 104 Illustrations. Large Crown 8vo, cloth **Net 7/6**

AËRIAL OR WIRE-ROPE TRAMWAYS. Their Construction and Management. By A. J. WALLIS-TAYLER, A.M.Inst.C.E. With 87 Illustrations. Crown 8vo. cloth 7/6

ARMATURE WINDINGS OF DIRECT CURRENT DYNA-
MOS. Extension and Application of a General Winding Rule. By E.
 ARNOEL, Technical Assistant Professor in Electro-Technics and Machine
 Construction, Royal Polytechnic School. Translated from the original German
 by F. L. L. DE GERS, M.E., Chief of Testing Department, Crocker-
 Wheeler Company. Medium 8vo, 120 pp., with over 140 illustrations. *Net 12/6*

BEAMS. EXPERIMENTS ON THEIR FLEXURE. Resulting in the Discovery of New Laws of Failure by Buckling. By ALBERT E. GUY. Medium 8vo, cloth *Net 9/0*

BLAST FURNACE CALCULATIONS AND TABLES FOR FURNACE MANAGERS AND ENGINEERS. Containing Rules and Formulae for Finding the Dimensions and Output Capacity of any Furnace, as well as the regular Outfit of Stoves, Heating Surface, Volume of Air, Tuyere Area, &c., per ton of Iron per day of 24 hours. By JOHN L. STEVENSON. F.Cap. 8vo. leather. *Net* 5/0

BOILER AND FACTORY CHIMNEYS. Their Draught-
Power and Stability. With a chapter on "Lightning Conductors." By ROBERT
WILSON, A.I.C.E., Author of "A Treatise on Steam Boilers," &c. Crown 8vo, cloth 3/6

BOILER CONSTRUCTION. A Practical Handbook for Engineers, Boiler-Makers, and Steam Users. Containing a large Collection of Rules and Data relating to Recent Practice in the Design, Construction, and Working of all Kinds of Stationary, Locomotive, and Marine Steam-Boilers. By WALTER S. HUTTON, Civil and Mechanical Engineer. With upwards of 500 Illustrations. Fourth Edition, carefully Revised, and Enlarged. Medium 8vo, over 680 pages, cloth, strongly bound **18/0**

HEAT, RADIATION, AND
INSULATION OF STEAM BOILERS.

OF BOILERS—CYLINDRICAL

TEMPERATURE
IS—CAULKING

"There has long been room for a modern handbook on steam boilers; there is not that room now, because Mr. Hutton has filled it. It is a thoroughly practical book for those who are occupied in the construction, design, selection, or use of boilers."—*Engineer*.

BOILERMAKER'S ASSISTANT. In Drawing, Templating, and Calculating Boiler Work, &c. By J. COURTNEY, Practical Boilermaker. Edited by D. K. CLARK, C.E. Seventh Edition. Crown 8vo, cloth **2/0**

BOILERMAKER'S READY RECKONER. With Examples of Practical Geometry and Templating for the Use of Platers, Smiths, and Riveters. By JOHN COURTNEY. Edited by D. K. CLARK, M.Inst.C.E. Crown 8vo, cloth **4/0**

BOILERMAKER'S READY RECKONER & ASSISTANT, being the two previous mentioned volumes bound together in one volume. With Examples of Practical Geometry and Templating, for the Use of Platers, Smiths, and Riveters. By JOHN COURTNEY. Edited by D. K. CLARK, M.Inst.C.E. Fifth Edition, 480 pp., with 140 Illustrations. Crown 8vo, half bound **7/0**

"No workman or apprentice should be without this book."—*Iron Trade Circular*

BOILER MAKING AND PLATING. A Practical Handbook for Workshop Operations. By JOSEPH G. HORNER, A.M.I.M.E. 380 pp. with 338 Illustrations. Crown 8vo, cloth **7/6**

BOILERS (STEAM). Their Construction and Management. By R. ARMSTRONG, C.E. Illustrated. Crown 8vo, cloth **1/6**

BOILERS. Their Strength, Construction, and Economical Working. By R. WILSON, C.E. Fifth Edition. 12mo, cloth **8/0**

BRIDGE CONSTRUCTION IN CAST AND WROUGHT

IRON. A Complete and Practical Treatise on, including Iron Foundations. In Three Parts.—Theoretical, Practical, and Descriptive. By WILLIAM HUMBER A.M.Inst.C.E., and M.Inst.M.E. Third Edition, revised and much improved, with 115 Double Plates (20 of which now first appear in this edition), and numerous Additions to the Text. In 2 vols., imp. 4to, half-bound in morocco **£6 16s. 6d.**

"In addition to elevations, plans, and sections, large scale details are given, which very much enhance the instructive work of these illustrations."—*Civil Engineer and Architect's Journal*.

BRIDGES AND VIADUCTS, IRON AND STEEL.

A Practical Treatise upon their Construction. For the use of Engineers, Draughtsmen, and Students. By FRANCIS CAMPIN, C.E. Crown 8vo, cloth **3/6**

BRIDGES (IRON) OF MODERATE SPAN:

Their Construction and Erection. By H. W. PENDRED. With 40 illustrations. Crown 8vo, cloth **2/0**

BRIDGES, OBLIQUE.

A Practical and Theoretical Essay. With 13 large Plates. By the late GEORGE WATSON BUCK, M.Inst.C.E. Fourth Edition, revised by his Son, J. H. WATSON BUCK, M.Inst.C.E.; and with the addition of Description to Diagrams for Facilitating the Construction of Oblique Bridges, by W. H. BARLOW, M.Inst.C.E. Royal 8vo, cloth **12/0**

"As a guide to the engineer and architect, on a confessedly difficult subject, Mr. Buck's work is unsurpassed."—*Building News*.

BRIDGES, TUBULAR AND OTHER IRON GIRDER.

Describing the Britannia and Conway Tubular Bridges. With a Sketch of Iron Bridges, &c. By G. D. DEMPSEY, C.E. Crown 8vo, cloth . . . **2/0**

CALCULATOR (NUMBER, WEIGHT, AND FRACTIONAL).

Containing upwards of 250,000 Separate Calculations, showing at a Glance the Value at 422 Different Rates, ranging from $\frac{1}{16}$ th of a Penny to 20s. each, or per cwt., and £20 per ton, of any number of articles consecutively, from 1 to 470. Any number of cwt.s., qrs., and lbs., from 1 cwt. to 470 cwt.s. Any number of tons, cwt.s., qrs., and lbs., from 1 to 1,000 tons. By WILLIAM CHADWICK, Public Accountant. Fourth Edition, Revised and Improved. 8vo, strongly bound **18/0**

CALCULATOR (WEIGHT).

Being a Series of Tables upon a New and Comprehensive Plan, exhibiting at one Reference the exact Value of any Weight from 1 lb. to 15 tons, at 300 Progressive Rates, from 1d. to 168s. p.r. cwt., and containing 186,000 Direct Answers, which, with their Combinations, consisting of a single addition (mostly to be performed at sight), will afford an aggregate of 10,266,000 Answers; the whole being calculated and designed to ensure correctness and promote despatch. By HENRY HARBEN, Accountant. Sixth Edition, carefully Corrected. Royal 8vo, strongly half-bound **£1 6s.**

CHAIN CABLES AND CHAINS. Comprising Sizes and Curves of Links, Studs, etc., Iron for Cables and Chains, Chain Cable and Chain Making, Forming and Welding Links, Strength of Cables and Chains, Certificates for Cables, Marking Cables, Prices of Chain Cables and Chains, Historical Notes, Acts of Parliament, Statutory Tests, Charges for Testing, List of Manufacturers of Cables, etc., etc. By THOMAS W. TRAILL, F.R.S.N., M.Inst.C.E., Engineer-Surveyor-in-Chief, Board of Trade, Inspector of Chain Cable and Anchor Proving Establishments, and General Superintendent, Lloyd's Committee on Proving Establishments. With numerous Tables, Illustrations, and Lithographic Drawings. Folio, cloth **£2 2s.**

CIVIL ENGINEERING. By HENRY LAW, M.Inst.C.E. Including a Treatise on Hydraulic Engineering by G. R. BURNELL, M.Inst.C.E. Seventh Edition, revised, with Large Additions on Recent Practice by D. KINNEAR CLARK, M.Inst.C.E. Crown 8vo, cloth **6/6**

CONDUCTORS FOR ELECTRICAL DISTRIBUTION. Their Materials and Manufacture, The Calculation of Circuits, Pole-Line Construction, Underground Working, and other Uses. By F. A. C. PERRINE, A.M., D.Sc.; formerly Professor of Electrical Engineering, Leland Stanford, Jr., University; M.Amer.I.E.E. Medium 8vo, 300 pp., fully illustrated, including Folding Plates and Diagrams. **Net 20/0**

CONTINUOUS RAILWAY BRAKES. A Practical Treatise on the several Systems in Use in the United Kingdom, their Construction and Performance. By M. REYNOLDS. 8vo, cloth. **9/0**

CRANES, the Construction of, and other Machinery for Raising Heavy Bodies for the Erection of Buildings, &c. By J. GLYNN, F.R.S. Crown 8vo, cloth. **1/6**

CURVES, TABLES OF TANGENTIAL ANGLES AND MULTIPLES. For Setting-out Curves from 5 to 200 Radius. By A. BEAZELEY, M.Inst.C.E. 7th Edition, Revised. With an Appendix on the use of the Tables for Measuring up Curves. Printed on 50 Cards, and sold in a cloth box, waistcoat-pocket size. **3/6**

"Each table is printed on a small card, which, placed on the theodolite, leaves the hands free to manipulate the instrument—no small advantage as regards the rapidity of work."—*Engineer.*

DRAINAGE OF LANDS, TOWNS AND BUILDINGS. By G. D. DEMPSEY, C.E. Revised, with large Additions on Recent Practice in Drainage Engineering by D. KINNEAR CLARK, M.Inst.C.E. Fourth Edition. Crown 8vo, cloth. **4/6**

DYNAMIC ELECTRICITY AND MAGNETISM, ELEMENTS OF. A Handbook for Students and Electrical Engineers. By PHILIP ATKINSON, A.M., Ph.D. Crown 8vo, cloth, 417 pp., with 120 Illustrations. **10/6**

DYNAMO BUILDING. HOW TO MAKE A DYNAMO. A Practical Treatise for Amateurs. By ALFRED CROFTS. Crown 8vo, cloth. **2/0**

DYNAMO ELECTRIC MACHINERY. By SAMUEL SHELDON, A.M., Ph.D., Professor of Physics and Electrical Engineering at the Polytechnic Institute of Brooklyn, etc., assisted by HOBART MASON, B.S., E.E.

In two volumes (sold separately).

Vol. I.—DIRECT CURRENT MACHINES. Sixth Edition, Revised. 202 Illustrations *Net 12/0*

Vol. II.—ALTERNATING CURRENT MACHINES. Fifth Edition. With 184 Illustrations *Net 12/0*

DYNAMO MANAGEMENT. A Handybook of Theory and Practice for the Use of Mechanics, Engineers, Students, and others in Charge of Dynamos. By G. W. LUMMIS-PATERSON, Electrical Engineer. Third Edition, Revised. Crown 8vo, 260 pp., with 100 illustrations, cloth . *4/6*

ELECTRICAL UNITS—MAGNETIC PRINCIPLES—THEORY OF THE DYNAMO—ARMATURES—ARMATURES IN PRACTICE—FIELD MAGNETS—FIELD MAGNETS IN PRACTICE—REGULATION DYNAMOS—COUPLING DYNAMOS—RUNNING DYNAMOS—FAULTS IN DYNAMOS—FAULTS IN ARMATURES—MOTORS.

"The book may be confidently recommended."—*Engineer*.

DYNAMO, MOTOR AND SWITCHBOARD CIRCUITS FOR ELECTRICAL ENGINEERS. A Practical Book dealing with the subject of Direct, Alternating and Polyphase Currents. By WILLIAM R. BOWKER, C.E., M.E., E.E. Medium 8vo, cloth. 109 Diagrams *Net 6/0*

... .. "B—METHODS OF ALTER- OF POWER— REVERSIBLE TRACTION MS—MOTOR VITCHBOARD

CIRCUITS, ETC.

DYNAMOS (ALTERNATING AND DIRECT CURRENT).

A Text-book on their Construction for Students, Engineer-Constructors and Electricians-in-Charge. By TYSON SEWELL, A.M.I.E.E., Lecturer and Demonstrator in Electrical Engineering at the Polytechnic, Regent Street, London, author of "The Elements of Electrical Engineering." 328 pp., with over 230 Illustrations. Large crown 8vo, cloth. [Just published. *Net 7/6*

FUNDAMENTAL PRINCIPLES OF DIRECT CURRENTS—THE MAGNETIC FIELD—THE PRODUCTION OF AN ELECTROMOTIVE FORCE—FUNDAMENTAL PRINCIPLES OF ALTERNATING CURRENTS—THE MAGNETIC FIELD—THE CAPACITY OF THE CIRCUIT—BIPOLAR DYNAMO CONSTRUCTION—THEORY OF BIPOLAR MACHINES—BIPOLAR DYNAMO DESIGN—MULTIPOLAR DYNAMO CONSTRUCTION—MULTIPOLAR DYNAMO DESIGN—SINGLE PHASE ALTERNATORS—CONSTRUCTION OF ALTERNATORS—POLYPHASE ALTERNATORS—EXCITING, COMPOUNDING AND SYNCHRONISING OF ALTERNATORS.

EARTHWORK DIAGRAM. These Diagrams or Scales have been designed with the intention of reducing the labour connected with the computation of earthwork quantities, and especially those of railways and roads. It has been found in the Authors practice that they are much quicker, and at the same time as accurate and much more complete than most of the tables heretofore published. By R. A. ERSKINE-MURRAY, A.M.Inst.C.E., and Y. D. KIRTON, A.M.Can.Soc.C.E. On a sheet in a roll, *net 5/0*, or mounted on card. [Just published. *Net 7/6*

EARTHWORK MANUAL. By ALEX. J. GRAHAM, C.E. With numerous Diagrams. Second Edition. 18mo, cloth *2/6*

EARTHWORK TABLES. Showing the Contents in Cubic Yards of Embankments, Cuttings, &c., of Heights or Depths up to an average of 80 feet By JOSEPH BROADBENT, C.E., and FRANCIS CAMPIN, C.E. Crown 8vo, cloth **5/0**

EARTHWORK TABLES, HANDY GENERAL. Giving the Contents in Cubic Yards of Centre and Slopes of Cuttings and Embankments from 3 inches to 80 feet in Depth or Height, for use with either 66 feet Chain or 100 feet Chain. By J. H. WATSON BUCK, M.Inst.C.E. On a Sheet mounted in cloth case **3/6**

ELECTRIC LIGHT. Its Production and Use. By J. W. URQUHART. Crown 8vo, cloth **7/6**

ELECTRIC LIGHT FITTING. A Handbook for Working Electrical Engineers. By J. W. URQUHART. Crown 8vo, cloth . . . **5/0**

ELECTRIC LIGHT FOR COUNTRY HOUSES. A Practical Handbook, including Particulars of the Cost of Plant, and Working. By J. H. KNIGHT. Crown 8vo, wrapper **1/0**

ELECTRIC LIGHTING. By ALAN A. CAMPBELL SWINTON, M.Inst.C.E., M.I.E.E. Crown 8vo, cloth **1/6**

ELECTRIC LIGHTING AND HEATING POCKET BOOK. Comprising useful Formulae, Tables, Data, and Particulars of Apparatus and Appliances for the use of Central Stations Engineers, Contractors, and Engineers-in-Charge. By SYDNEY F. WALKER, R.N., M.I.E.E., M.I.M.E., A.M.Inst.C.E., Etc. Fcap 8vo, 448 pp., 270 Diagrams, and 240 Tables. [Just published. Net **7/6**

DEFINITIONS—DIFFERENT UNITS EMPLOYED—LAWS OF ELECTRIC CIRCUITS—EFFECTS OF RESISTANCE—LAW OF CONTINUOUS AND ALTERNATING CURRENTS—EFFECTS OF ELECTROMAGNETISM AND ELECTRO-STATIC INDUCTION—ELECTRICITY GENERATORS—ACCUMULATORS—SWITCHBOARDS—SWITCHES, CIRCUIT-BREAKERS, ETC.—CABLES—METHODS OF INSULATION—SIZES AND INSULATION OF CABLES MADE BY LEADING MAKERS—CONDUITS—LEADING WIRES AND OTHER ACCESSORIES—MEASURING INSTRUMENTS OF ALL KINDS AND APPARATUS FOR TESTING LAMPS AND ACCESSORIES—APPARATUS FOR HEATING BY ELECTRICITY.

ELECTRIC SHIP-LIGHTING. A Handbook on the Practical Fitting and Running of Ships' Electrical Plant. By J. W. URQUHART. Crown 8vo, cloth **7/6**

ELECTRIC-WIRING, DIAGRAMS & SWITCH-BOARDS. By NEWTON HARRISON, E.E., Instructor of Electrical Engineering in the Newark Technical School. Crown 8vo, cloth. *Net* **5/0**

THE PRINCIPLES OF WIRING—CALCULATING THE SIZE OF WIRE—A SIMPLE RULE FOR ESTIMATING THE SIZE OF WIRE—ESTIMATING THE MAINS, FEEDERS, AND SUB-MAIN WIRE—WIRING FOR TESTING—THE INSULATION RESISTANCE—WIRING FOR LIGHTING—WIRING FOR HEATING—WIRING FOR POWER—WIRING FOR TRAMWAYS—WIRING FOR LAMPS—LIGHTING OF A ROOM—SWITCHBOARDS AND THEIR PURPOSE—SWITCHBOARDS DESIGNED FOR SHUNT AND COMPOUND-WOUND DYNAMOS—PANEL SWITCHBOARDS, STREET RAILWAY SWITCHBOARDS, L.C.—GROUND DETECTOR—LOCATING GROUNDS—ALTERNATING CURRENTS—POWER FACTOR IN CIRCUITS—CALCULATION OF SIZES OF THREE-PHASE CIRCUITS.

ELECTRICAL AND MAGNETIC CALCULATIONS. For the Use of Electrical Engineers and Artisans, Teachers, Students, and all others interested in the Theory and Application of Electricity and Magnetism. By A. A. ATKINSON, M.S., Professor of Physics and Electricity in Ohio University, Athens, Ohio. Crown 8vo, cloth *Net 9/0*

ELECTRICAL DICTIONARY. A Popular Encyclopædia of Words and Terms Used in the Practice of Electrical Engineering. By T. O'CONOR SLOANE, A.M., E.M., Ph.D., Author of "Arithmetic of Electricity," "Electricity Simplified," "Electric Toy Making," etc. Third Edition, with Appendix. 690 pages and nearly 400 Illustrations. Large Crown 8vo, cloth *Net 7/6*

"The work has many attractive features in it, and is, beyond doubt, a well put together and useful publication. The amount of ground covered may be gathered from the fact that in the index about 5,000 references will be found."—*Electrical Review*.

ELECTRICAL ENGINEERING. A First-Year's Course for Students. By TYSON SEWELL, A.I.E.E., Lecturer and Demonstrator in Electrical Engineering at the Polytechnic, Regent Street, London. Fourth Edition, Revised, with additions. Large Crown 8vo, cloth 462 pp., with 278 Illustrations *Net 5/0*

AND THE
TIAL DIR-
IPS—INCAN-
—THE CON-
CURRENTS
WORKING—
ANSWERS.

"Distinctly one of the best books for those commencing the study of electrical engineering. Everything is explained in simple language which even a beginner cannot fail to understand."—*The Engineer*.

ELECTRICAL ENGINEERING (ELEMENTARY). In Theory and Practice. A Class Book for Junior and Senior Students and Working Electricians. By J. H. ALEXANDER. With nearly 200 Illustrations. Crown 8vo, cloth *Net 3/6*

FUNDAMENTAL PRINCIPLES—ELECTRICAL CURRENTS—SOLENOID COILS, GALVANO-
METERS—VOLT-METERS—MEASURING INSTRUMENTS—ALTERNATING CURRENTS—
DYNAMO ELECTRIC MACHINES—CONTINUOUS CURRENT DYNAMOS—INDUCTION, STATIC
TRANSFORMERS, CONVERTERS—MOTORS—PRIMARY AND STORAGE CELLS—ARC LAMPS
—INCANDESCENT LAMPS—SWITCHES, FUSES, ETC.—CONDUCTORS AND CABLES—ELEC-
TRICAL ENERGY METERS—SPECIFICATIONS—GENERATION AND TRANSMISSION OF
ELECTRICAL ENERGY—GENERATING STATIONS.

ELECTRICAL TRANSMISSION OF ENERGY. A Manual for the Design of Electrical Circuits. By ARTHUR VAUGHAN ABBOTT, C.E., Member American Institute of Electrical Engineers, Member American Institute of Mining Engineers, Member American Society of Civil Engineers, Member American Society of Mechanical Engineers, etc. Fourth Edition, entirely Re-Written and Enlarged, with numerous Tables, 16 Plates, and nearly 400 other Illustrations. Royal 8vo, 700 pages. Strongly bound in cloth *Net 30/0*

INTRODUCTION—THE PROPERTIES OF WIRE—THE CONSTRUCTION OF AERIAL
CIRCUITS—GENERAL LINE WORK—ELECTRIC RAILWAY CIRCUITS—PROTECTION—THE
CONSTRUCTION OF UNDERGROUND CIRCUITS—CONDUITS—CABLES AND CONDUIT CON-
DUCTORS—SPECIAL RAILWAY CIRCUIT—THE INTERURBAN TRANSMISSION LINE—THE
THIRD RAIL—THE URBAN CONDUIT—ELECTRICAL MEASUREMENT—CONTINUOUS-CURRENT
CONDUCTORS—CONDUCTORS FOR ALTERNATING
PARALLEL DISTRIBUTION—MISCELLANEOUS MET
THE COST OF PRODUCTION AND DISTRIBUTION.

NOTE.—This Volume forms an indispensable Work for Electrical Engineers, Railway and Tramway Managers and Directors, and all interested in Electric Traction.

ELECTRICITY AS APPLIED TO MINING. By ARNOLD

LUPTON, M.Inst.C.E., M.I.Mech.E., M.I.E.E., late Professor of Coal Mining at the Yorkshire College, Victoria University, Mining Engineer and Colliery Manager; G. D. ASPINALL PARR, M.I.E.E., A.M.I.Mech.E., Associate of the Central Technical College, City and Guilds of London, Head of the Electrical Engineering Department, Yorkshire College, Victoria University; and HERBERT PERKIN, M.I.M.E., Certificated Colliery Manager, Assistant Lecturer in the Mining Department of the Yorkshire College, Victoria University. Second Edition, Revised and Enlarged. Medium 8vo, cloth, 300 pp., with about 170 Illustrations **Net 12/0**

INTRODUCTORY—
TURBINE—DISTRIBUTION—
TRICAL GENERATORS AND
—ELECTRICITY APPLIED
CUTTING—TYPICAL EL
ARC AND GLOW LAMPS—MISCELLANEOUS APPLICATIONS OF I
AS COMPARED WITH OTHER MODES OF TRANSMITTING
TRICITY.

1 STEAM
G. ELEC-
PLANTS
TO COAL
TING BY

"The book is a good attempt to meet a growing want, and is well worthy of a place in the mining engineer's library."—*The Electrician*.

ELECTRICITY. A STUDENT'S TEXT-BOOK. By H.

M. NOAD, F.R.S. 650 pp., with 470 Illustrations. Crown 8vo **9/0**

ELECTRICITY, POWER TRANSMITTED BY, AND

APPLIED BY THE ELECTRIC MOTOR, including Electric Railway Construction. By PHILIP ATKINSON, A.M., Ph.D., author of "Elements of Static Electricity." Fourth Edition, Enlarged, Crown 8vo, cloth, 224 pp., with over 90 illustrations **Net 9/0**

ELECTRO-PLATING AND ELECTRO-REFINING OF

METALS. Being a new edition of Alexander Watt's "Electro-Deposition." Revised and Largely Re-written by ARNOLD PHILIP, Assoc. R.S.M., B.Sc., A.I.E.E., F.I.C., Principal Assistant to the Admiralty Chemist, formerly Chief Chemist to the Engineering Departments of the India Office, and sometime Assistant Professor of Electrical Engineering and Applied Physics at the Heriot-Watt College, Edinburgh. 700 pp., with numerous Illustrations. Large Crown 8vo, cloth **Net 12/6**

ENGINE-DRIVING LIFE. Stirring Adventures and Incidents

in the Lives of Locomotive Engine-Drivers. By MICHAEL REYNOLDS. Third Edition. Crown 8vo, cloth **1/6**

ENGINEERING DRAWING. A WORKMAN'S MANUAL.

By JOHN MAXTON, Instructor in Engineering Drawing, Royal Naval College, Greenwich. Eighth Edition. 300 Plates and Diagrams. Crown 8vo, cloth **3/6**

"A copy of it should be kept for reference in every drawing office."—*Engineering*.

ENGINEERING ESTIMATES, COSTS, AND ACCOUNTS.

A Guide to Commercial Engineering. With numerous examples of Estimates and Costs of Millwright Work, Miscellaneous Productions, Steam Engines and Steam Boilers; and a Section on the Preparation of Costs Accounts. By A GENERAL MANAGER. Second Edition. 8vo, cloth. **12/0**

"The information given is plain and clear, and the book is well adapted for the use of the student and the practical engineer."—*The Engineer*.

ENGINEERING PROGRESS (1863-6). By WM. HUMBER, A.M.Inst.C.E. Complete in Four Vols. Containing 148 Double Plates, with Portraits and Copious Descriptive Letterpress. Impl. 4to, half-morocco. Price, complete, **£12 12s.**; or each Volume sold separately at **£3 3s.** per Volume. *Descriptive List of Contents on application.*

ENGINEER'S AND MILLWRIGHT'S ASSISTANT. A Collection of Useful Tables, Rules, and Data. By WILLIAM TEMPLETON. Eighth Edition, with Additions. 18mo, cloth **2/6**

"A deservedly popular work. It should be in the 'drawer' of every mechanic."—*English Mechanic.*

ENGINEER'S HANDBOOK. A Practical Treatise on Modern Engines and Boilers, Marine, Locomotive, and Stationary. And containing a large collection of Rules and Practical Data relating to Recent Practice in Designing and Constructing all kinds of Engines, Boilers, and other Engineering work. The whole constituting a comprehensive Key to the Board of Trade and other Examinations for Certificates of Competency in Modern Mechanical Engineering. By WALTER S. HUTTON, Civil and Mechanical Engineer, Author of "The Works' Manager's Handbook for Engineers," &c. With upwards of 420 Illustrations. Sixth Edition, Revised and Enlarged. Medium 8vo, nearly 560 pp., strongly bound **18/0**

"A mass of information set down in simple language, and in such a form that it can be easily referred to at any time. . . . good and well chosen, and is greatly elucidated by the illustrations. . . . to most engineers' shelves, where it will rank as one of the most useful books of reference."—*Practical Engineer.*

"Full of useful information, and should be found on the office shelf of all practical engineers."—*English Mechanic.*

ENGINEER'S, MECHANIC'S, ARCHITECT'S, BUILDER'S, ETC. TABLES AND MEMORANDA. Selected and Arranged by FRANCIS SMITH. Seventh Edition, Revised, including ELECTRICAL TABLES, FORMULÆ, and MEMORANDA. Waistcoat-pocket size, limp leather **1/6**

"The best example we have ever seen of 270 pages of useful matter packed into the dimensions of a card-case."—*Building News.*

ENGINEER'S YEAR-BOOK FOR 1907. Comprising Formulæ, Rules, Tables, Data and Memoranda in Civil, Mechanical, Electrical, Marine and Mine Engineering. By H. R. KEMPE, M.Inst.C.E., Principal Staff Engineer, Engineer-in-Chief's Office, General Post Office, London, Author of "A Handbook of Electrical Testing," "The Electrical Engineer's Pocket-Book," &c. With 1,000 Illustrations, specially Engraved for the work. Crown 8vo, 950 pp., leather. [Just Published. **8/0**

"Kempe's Year-Book really requires no commendation. Its sphere of usefulness is widely known, and it is used by engineers the world over."—*The Engineer.*

"The volume is distinctly in advance of most similar publications in this country."—*Engineering.*

ENGINEER'S POCKET COMPANION, and Practical Educator for Enginemen, Boiler Attendants, and Mechanics. By MICHAEL REYNOLDS. With 45 Illustrations and numerous Diagrams. Fifth Edition. Royal 18mo, strongly bound for pocket wear **3/6**

EXCAVATION (EARTH AND ROCK). A Practical Treatise,
by CHARLES PRELINI, C.E. 365 pp., with Tables, many Diagrams and
Royal 8vo, cloth. *Net 16/0*

JURY ACCOUNTS: their PRINCIPLES & PRACTICE.
A Handbook for Accountants and Manufacturers. By E. GÄRCKE and J. M.
FELLS. Crown 8vo, cloth *7/6*

FIRES, FIRE-ENGINES, AND FIRE BRIGADES. With
a History of Fire-Engines, their Construction, Use, and Management.
Hints on Fire-Brigades, &c. By C. F. T. YOUNG, C.E. 8vo, cloth, *£1 4s.*

FOUNDATIONS AND CONCRETE WORKS. With Practical
Remarks on Footings, Planking, Sand and Concrete, Béton, Pile-driving,
Caissons, and Cofferdams. By E. DOBSON. Crown 8vo. *1/6*

FUEL, ITS COMBUSTION AND ECONOMY. Consisting
of an Abridgment of "A Treatise on the Combustion of Coal and the
Prevention of Smoke." By C. W. WILLIAMS, A.Inst.C.E. With extensive
Additions by D. KINNEAR CLARK, M.Inst.C.E. Fourth Edition. Crown
8vo, cloth *3/6*

FUELS: SOLID, LIQUID, AND GASEOUS. Their Analysis
and Valuation. For the use of Chemists and Engineers. By H. J. PHILLIPS
F.C.S., formerly Analytical and Consulting Chemist to the Great Eastern
Railway. Fourth Edition. Crown 8vo, cloth *2/0*

GAS AND OIL ENGINE MANAGEMENT. A Practical
Guide for Users and Attendants, being Notes on Selection, Construction, and
Management. By M. POWIS BALE, M.Inst.C.E., M.I. Mech.E. Author of
"Woodworking Machinery," &c. Second Edition, with an additional Chapter
on Gas Producers. Crown 8vo, cloth *Net 3/6*

SELECTING AND FIXING A GAS ENGINE—PRINCIPLES OF WORKING, ETC.—FAILURES
AND DEFECTS—VALVES, IGNITION, PISTON RINGS, ETC.—OIL ENGINES—GAS PRODUCERS
—RULES, TABLES, ETC.

GAS ENGINEER'S POCKET-BOOK. Comprising Tables,
Notes and Memoranda relating to the Manufacture, Distribution, and Use of
Coal Gas and the Construction of Gas Works. By H. O'CONNOR, A.M.Inst.
C.E. Third Edition, Revised. Crown 8vo, leather.

[Just Published. *Net 10/6*

"The book contains a vast amount of information"—*Gas World*.

GAS-ENGINE HANDBOOK. A Manual of Useful Infor-
mation for the Designer and the Engineer. By E. W. ROBERTS, M.E.
With Forty Full-page Engravings. Small Fcap. 8vo, leather *Net 8/6*

GAS-ENGINES AND PRODUCER-GAS PLANTS. A

Treatise setting forth the Principles of Gas Engines and Producer Design, the Selection and Installation of an Engine, the Care of Gas Engines and Producer-Gas Plants, with a Chapter on Volatile Hydrocarbon and Oil Engines. By R. E. MATHOT, M.E. Translated from the French. With a Preface by DUGALD CLERK, M.Inst.C.E., F.C.S. Medium 8vo, cloth, 350 pages, with about 150 Illustrations. *Net 12/0*

MOTIVE POWER AND COST OF INSTALLATION—SELECTION OF AN ENGINE—INSTALLATION OF AN ENGINE—FOUNDATION AND EXHAUST—WATER CIRCULATION—LUBRICATION—CONDITIONS OF PERFECT OPERATION—HOW TO START AN ENGINE—PRECAUTIONS—PERTURBATIONS IN THE OPERATION OF ENGINES—PRODUCER-GAS ENGINES—PRODUCER-GAS—PRESSURE GAS-PRODUCERS—SUCTION GAS-PRODUCERS—OIL AND VOLATILE HYDROCARBON ENGINES—THE SELECTION OF AN ENGINE.

GAS ENGINES. With Appendix describing a Recent Engine with Tube Igniter. By T. M. GOODEVE, M.A. Crown 8vo, cloth *2/6*

GAS MANUFACTURE, CHEMISTRY OF. A Practical

Manual for the Use of Gas Engineers, Gas Managers and Students. By HAROLD M. ROYLE, F.C.S., Chief Chemical Assistant at the Becton Gas Works. Demy 8vo, cloth. 340 pages, with numerous Illustrations and Coloured Plate [*Just published, Net 12/6*]

PREPARATION OF STANDARD SOLUTIONS—ANALYSIS OF COALS—DESCRIPTION OF VARIOUS TYPES OF FURNACES—PRODUCTS OF CARBONISATION AT VARIOUS TEMPERATURES—ANALYSIS OF CRUDE GAS—ANALYSIS OF LIME—ANALYSIS OF AMMONIACAL LIQUOR—ANALYTICAL VALUATION OF OXIDE OF IRON—ESTIMATION OF NAPHTHALIN—ANALYSIS OF FIRE-BRICKS AND FIRE-CLAY—ART OF PHOTOMETRY—CARBURETTED WATER GAS—APPENDIX CONTAINING STATUTORY AND OFFICIAL REGULATIONS FOR TESTING GAS, VALUABLE EXCERPTS FROM VARIOUS IMPORTANT PAPERS ON GAS CHEMISTRY, USEFUL TABLES, MEMORANDA, ETC.

GAS WORKS. Their Construction and arrangement, and the Manufacture and Distribution of Coal Gas. By S. HUGHES, C.E. Ninth Edition. Revised, with Notices of Recent Improvements by HENRY O'CONNOR, A.M.Inst.C.E. Crown 8vo, cloth *6/-*

GEOMETRY. For the Architect, Engineer, and Mechanic, By E. W. TARN, M.A., Architect. 8vo, cloth *9/0*

GEOMETRY FOR TECHNICAL STUDENTS. By E. H. SPRAGUE, A.M.Inst.C.E. Crown 8vo, cloth. *Net 1/0*

GEOMETRY OF COMPASSES. By OLIVER BYRNE. Coloured Plates. Crown 8vo, cloth *3/6*

HEAT, EXPANSION OF STRUCTURES BY. By JOHN KEILY, C.E. Crown 8vo, cloth *3/6*

HOISTING MACHINERY. Including the Elements of Crane Construction and Descriptions of the Various Types of Cranes in Use. By JOSEPH HORNER, A.M.I.M.E. Crown 8vo, cloth, with 215 Illustrations, including Folding Plates *Net 7/6*

HYDRAULIC MANUAL. Consisting of Working Tables and Explanatory Text. Intended as a Guide in Hydraulic Calculations and Field Operations. By LEWIS D'A. JACKSON. Fourth Edition, Enlarged. Large crown 8vo, cloth *16/0*

HYDRAULIC POWER ENGINEERING. A Practical Manual on the Concentration and Transmission of Power by Hydraulic Machinery. By G. CROYDON MARKS, A.M.Inst.C.E. Second Edition, Enlarged, with about 240 Illustrations. 8vo, cloth. **Net 10/6**

SUMMARY OF CONTENTS:—PRINCIPLES OF HYDRAULICS.—THE FLOW OF WATER.—HYDRAULIC PRESSURES.—MATERIAL.—TEST LOAD.—PACKING FOR SLIDING SURFACES.—PIPE JOINTS.—CONTROLLING VALVES.—PLATFORM LIFTS.—WORKSHOP AND FOUNDRY CRANES.—WAREHOUSE AND DOCK CRANES.—SHEET M.—HYDRAULIC RIVETERS.—HAND AND POW.—IMPULSE TURBINES.—REACTION TURBINES.—WHEELS.—HYDRAULIC ENGINES.—RECENT ACTION OF PUMPS, &c.

"Can be unhesitatingly recommended as a useful and up-to-date manual on hydraulic transmission and utilisation of power."—*Mechanical World*.

HYDRAULIC TABLES, CO-EFFICIENTS, & FORMULÆ.

For Finding the Discharge of Water from Orifices, Notches, Weirs, Pipes, and Rivers. With New Formulæ, Tables, and General Information on Rain-fall, Catchment-Basins, Drainage, Sewerage, Water Supply for Towns and Mill Power. By JOHN NEVILLE, C.E., M.R.I.A. Third Edition, revised, with additions. Numerous Illustrations. Crown 8vo, cloth **14/0**

IRON AND METAL TRADES' COMPANION. For Expeditiously Ascertaining the Value of any Goods bought or sold by Weight, from 1s. per cwt. to 112s. per cwt., and from one farthing per pound to one shilling per pound. By THOMAS DOWNIE. Strongly bound in leather, 396 pp. **9/0**

IRON AND STEEL. A Work for the Forge, Foundry, Factory, and Office. Containing ready, useful, and trustworthy Information for Ironmasters and their Stock-takers; Managers of Bar, Rail, Plate, and Sheet Rolling Mills; Iron and Metal Founders; Iron Ship and Bridge Builders; Mechanical, Mining, and Consulting Engineers; Architects, Contractors, Builders, &c. By CHARLES HOARE, Author of "The Slide Rule," &c. Ninth Edition. 32mo, leather **6/0**

IRON AND STEEL CONSTRUCTIONAL WORK, as applied to Public, Private, and Domestic Buildings. By FRANCIS CAMPIN, C.E. Crown 8vo, cloth **3/6**

IRON & STEEL GIRDERS. A Graphic Table for facilitating the Computation of the Weights of Wrought Iron and Steel Girders, &c., for Parliamentary and other Estimates. By J. H. WATSON BUCK, M.Inst.C.E. On a Sheet. **2/6**

IRON-PLATE WEIGHT TABLES. For Iron Shipbuilders, Engineers, and Iron Merchants. Containing the Calculated Weights of upwards of 150,000 different sizes of Iron Plates from 1 foot by 6 in. by $\frac{1}{4}$ in. to 10 feet by 5 feet by 1 in. Worked out on the Basis of 40 lbs. to the square foot of Iron of 1 inch in thickness. By H. BURLINSON and W. H. SIMPSON. 4to, half-bound **£1 5s.**

LOCOMOTIVE ENGINE DEVELOPMENT. A Popular Treatise on the Gradual Improvements made in Railway Engines between 1803 and 1903. By CLEMENT C. STRETTON, C.E. Sixth Edition, Revised and Enlarged. Crown 8vo, cloth *Net 4/6*

LOCOMOTIVE ENGINE DRIVING. A Practical Manual for Engineers in Charge of Locomotive Engines. By MICHAEL REYNOLDS, M.S.E. Twelfth Edition. Crown 8vo, cloth, **3/6**; cloth boards **4/6**

LOCOMOTIVE ENGINES. A Rudimentary Treatise on. By G. D. DEMPSEY, C.E. With large Additions treating of the Modern Locomotive, by D. K. CLARK, M.Inst.C.E. With Illustrations. Crown 8vo, cloth **3/0**

LOCOMOTIVE (MODEL) ENGINEER, Fireman and Engine-Boy. Comprising a Historical Notice of the Pioneer Locomotive Engines and their Inventors. By MICHAEL REYNOLDS. Crown 8vo, cloth, **3/6**; cloth boards **4/6**

MACHINERY, DETAILS OF. Comprising Instructions for the Execution of various Works in Iron in the Fitting Shop, Foundry, and Boiler Yard. By FRANCIS CAMPIN, C.E. Crown 8vo, cloth . . . **3/0**

MACHINE SHOP TOOLS. A Practical Treatise describing in every detail the Construction, Operation and Manipulation of both Hand and Machine Tools; being a work of Practical Instruction in all Classes of Modern Machine Shop Practice, including Chapters on Filing, Fitting and Scraping Surfaces; on Drills, Reamers, Taps and Dies; the Lathe and its Tools; Planers, Shapers and their Tools; Milling Machines and Cutters; Gear Cutters and Gear Cutting; Drilling Machines and Drill Work; Grinding Machines and their Work; Hardening and Tempering, Gearing, Belting, and Transmission Machinery; Useful Data and Tables. By W. H. VAN DERVOORT, M.E. Illustrated by 673 Engravings. Medium 8vo. *Net 21/0*

MAGNETOS FOR AUTOMOBILISTS: How made and How used. A handbook on their Construction and Management. By S. R. BORTONE. Crown 8vo, cloth [*Just Published.* *Net 2/0*]

MARINE ENGINEERING. An Elementary Manual for Young Marine Engineers and Apprentices. By J. S. BREWER. Crown 8vo, cloth. **1/6**

MARINE ENGINEER'S GUIDE to Board of Trade Examinations for Certificates of Competency. Containing a
Date, with Simple, Clear, and Correct Solutions; 302
with Illustrated Answers, and Verbal Questions and Answers
of Drawings with Statements completed. By A. C. WANNAN, C.E., Consulting Engineer, and E. W. I. WANNAN, M.I.M.E., Certificated First Class Marine Engineer. With numerous Engravings. Fourth Edition, Enlarged. 500 pages. Large crown 8vo, cloth *Net 10/6*

MARINE ENGINEER'S POCKET-BOOK. Containing latest Board of Trade Rules and Data for Marine Engineers. By A. C. WANNAN. Fourth Edition, Revised, Enlarged, and Brought up to Date. Square 8mo, with thumb Index, leather **5/0**

MARINE ENGINES AND BOILERS. Their Design and Construction. A Handbook for the Use of Students, Engineers, and Naval Constructors. Based on the Work "Berechnung und Konstruktion der Schiffsmaschinen und Kessel," by Dr. G. BAUER, Engineer-in-Chief of the Vulcan Shipbuilding Yard, Stettin. Translated from the Second German Edition by E. M. DONKIN, and S. BRYAN DONKIN, A.M.I.C.E. Edited by LESLIE S. ROBERTSON, Secretary to the Engineering Standards Committee, M.I.C.E., M.I.M.E., M.I.N.A., &c. With numerous Illustrations and Tables. Medium 8vo, cloth **Net 25/-**

SUMMARY OF CONTENTS:—PART I.—MAIN ENGINES.—DETERMINATION OF CYLINDER DIMENSIONS.—THE UTILISATION OF STEAM IN THE ENGINE.—STROKE OF PISTON.—NUMBER OF REVOLUTIONS.—TURNING MOMENT.—BALANCING OF THE MOVING PARTS.—ARRANGEMENT OF MAIN ENGINES.—DETAILS OF MAIN ENGINES.—THE CYLINDER.—VALVES.—VARIOUS KINDS OF VALVE GEAR.—PISTON RODS.—PISTONS.—CONNECTING ROD AND CROSSHEAD.—VALVE GEAR RODS.—BED PLATES.—ENGINE COLUMNS.—REVERSING AND TURNING GEAR. PART II.—PUMPS.—AIR, CIRCULATING FEED, AND AUXILIARY PUMPS. PART III.—SHAFTING, RESISTANCE OF SHIPS, PROPELLERS.—THRUST SHAFT AND THRUST BLOCK.—TUNNEL SHAFTS AND PLUMMER BLOCKS.—THRUST COUPLINGS.—STERN TUBE.—THE SCREW PROPELLER.—CONSTRUCTION OF THE SCREW. PART IV.—PIPES AND CONNECTIONS.—GENERAL REMARKS, FLANGES, VALVES, &c.—UNDER WATER FITTINGS.—MAIN STEAM, AUXILIARY STEAM, AND EXHAUST PIPING.—FEED WATER, BILGE, BALLAST AND CIRCULATING PIPES. PART V.—STEAM BOILERS.—FIRING AND THE GENERATION OF STEAM.—CYLINDRICAL BOILERS.—LOCOMOTIVE BOILERS.—WATER-TUBE BOILERS.—SMALL TUBE WATER-TUBE BOILERS.—SMOKE BOX.—FUNNEL AND BOILER LAGGING.—FORCED DRAUGHT.—BOILER FITTINGS AND MOUNTINGS. PART VI.—MEASURING INSTRUMENTS. PART VII.—VARIOUS DETAILS.—BOLTS, NUTS, SCREW THREADS, &c.—PLATFORMS, GRATINGS, LADDERS.—FOUNDATIONS.—SEATINGS.—LUBRICATION.—VENTILATION OF ENGINE ROOMS.—RULES FOR SPARE GEAR. PART VIII.—ADDITIONAL TABLES.

"This handsome volume contains a complete and accurate account of the design and construction of modern marine engines and boilers, and represents recent practice for all purposes."

American constitutes a valuable book of reference and a treasury of information. The English editor and his assistants have done their work well, both in translation and in the conversion of metric to English measures." —*The Times*.

MARINE ENGINES AND STEAM VESSELS. By R. MURRAY, C.E. Eighth Edition, thoroughly Revised, with Additions by the Author and by GEORGE CARLISLE, C.E. Crown 8vo, cloth **4/6**

MASONRY DAMS FROM INCEPTION TO COMPLETION. Including numerous Formulæ, Forms of Specification and Tender, Pocket Diagram of Forces, &c. For the use of Civil and Mining Engineers. By C. F. COURTNEY, M.Inst.C.E. 8vo, cloth **9/0**

MASTING, MAST-MAKING, AND RIGGING OF SHIPS. Also Tables of Spars, Rigging, Blocks; Chain, Wire, and Hemp Ropes, &c., relative to every class of vessels. By R. KIPPING. Crown 8vo, cloth **2/0**

MATERIALS AND CONSTRUCTION. A Theoretical and Practical Treatise on the Strains, Designing, and Erection of Works of Construction. By F. CAMPIN. Crown 8vo, cloth **3/0**

MATERIALS, A TREATISE ON THE STRENGTH OF.

By P. BARLOW, F.R.S., P. W. BARLOW, F.R.S., and W. H. BARLOW, F.R.S.
 Edited by WM. HUMBER, A.M.Inst.C.E. 8vo, cloth 18/0
 "The standard treatise on that particular subject."—*Engineer*.

MATHEMATICAL TABLES. For Trigonometrical, Astronomical, and Nautical Calculations; to which is added a Treatise on Logarithms, by H. LAW, C.E. With Tables of Logarithms and Nautical Astronomy. By Prof. J. R. YOUNG. Crown 8vo, cloth 4/0

MECHANICAL ENGINEERING. Comprising Metallurgy, Moulding, Casting, Forging, Tools, Workshop Machinery, Mechanical Manipulation, Manufacture of the Steam Engine, &c. By FRANCIS CAMPIN, C.E. Third Edition. Crown 8vo, cloth 2/6

MECHANICAL ENGINEERING TERMS. (Lockwood's Dictionary). Embracing terms current in the Drawing Office, Pattern Shop, Foundry, Fitting, Turning, Smiths', and Boiler Shops, &c. Comprising upwards of 6,000 Definitions. Edited by J. G. HORNER, A.M.I.M.E. Third Edition, Revised, with Additions. Crown 8vo, cloth Net 7/6

MECHANICAL ENGINEER'S COMPANION. Areas, Circumferences, Decimal Equivalents, in inches and feet, millimetres, squares, cubes, roots, &c.; Strength of Bolts, Weight of Iron, &c.; Weights, Measures, and other Data. Also Practical Rules for Engine Proportions. By R. EDWARDS, M.Inst.C.E. Fcap. 8vo, cloth 3/6

MECHANICAL ENGINEER'S POCKET-BOOK. Comprising Tables, Formulæ, Rules, and Data: A Handy Book of Reference for Daily Use in Engineering Practice. By D. KINNEAR CLARK, M.Inst.C.E., Sixth Edition, thoroughly Revised and Enlarged. By H. H. P. POWLES, A.M.Inst.C.E., M.I.M.E. Small 8vo, 700 pp., Leather [Just published. Net 6/0]

MATHEMATICAL TABLES.—MEASUREMENT OF SURFACES AND SOLIDS.—ENGLISH WEIGHTS AND MEASURES.—FRENCH METRIC WEIGHTS AND MEASURES.—FOREIGN WEIGHTS AND MEASURES.—MONEYS.—SPECIFIC GRAVITY, WEIGHT, AND VOLUME.—MANUFACTURED METALS.—STEEL PIPES.—BOLTS AND NUTS.—SUNDRY ARTICLES IN WROUGHT AND CAST IRON, COPPER, BRASS, LEAD, TIN, ZINC.—STRENGTH OF MATERIALS.—STRENGTH OF TIMBER.—STRENGTH OF CAST IRON.—STRENGTH OF WROUGHT IRON.—STRENGTH OF STEEL.—TENSILE STRENGTH OF COPPER,

STEEL, AND IRON.—STRENGTH OF BRASS.—STRENGTH OF LEAD.—STRENGTH OF TIN.—STRENGTH OF ZINC.—STRENGTH OF WROUGHT IRON.—STRENGTH OF STEEL.—TENSILE STRENGTH OF COPPER, STEEL, AND IRON.—STRENGTH OF BRASS.—STRENGTH OF LEAD.—STRENGTH OF TIN.—STRENGTH OF ZINC.—STRENGTH OF WROUGHT IRON.—STRENGTH OF STEEL.—TENSILE STRENGTH OF COPPER, STEEL, AND IRON.—STRENGTH OF BRASS.—STRENGTH OF LEAD.—STRENGTH OF TIN.—STRENGTH OF ZINC.—STRENGTH OF WROUGHT IRON.—STRENGTH OF STEEL.—TENSILE STRENGTH OF COPPER,

"It would be found difficult to compress more matter within a similar compass, or produce a book of 700 pages which should be more compact or convenient for pocket reference. . . . Will be appreciated by mechanical engineers of all classes."—*Practical Engineer*.

MECHANICAL ENGINEER'S REFERENCE BOOK. For Machine and Boiler Construction. By NELSON FOLEY, M.I.N.A. New Edition, Revised throughout and much Enlarged. To be issued in parts. [In Preparation.]

"Mr. Foley is well fitted to compile such a work. The diagrams are a great feature of the work. It may be stated that Mr. Foley has produced a volume which will undoubtedly fulfil the desire of the author and become indispensable to all mechanical engineers."—*Marine Engineer*.

"We have carefully examined this work, and pronounce it a most excellent reference book for the use of marine engineers."—*Journal of American Society of Naval Engineers*.

MECHANICAL HANDLING OF MATERIAL. A

Treatise on the Handling of Material such as Coal, Ore, Timber, &c., by Automatic or Semi-Automatic Machinery, together with the Various Accessories used in the Manipulation of such Plant, and Dealing fully with the Handling, Storing, and Warehousing of Grain. By G. F. ZIMMER, A.M.Inst.C.E. 528 pages Royal 8vo, cloth, with 550 Illustrations (including Folding Plates) specially prepared for the Work *Net 25/0*

"It is an essentially practical work written by a practical man, who is not only thoroughly acquainted with his subject theoretically, but who also has the knowledge that can only be obtained by actual experience in working and planning installations for the mechanical handling of raw material."—*The Times*.

MECHANICS. Being a concise Exposition of the General

Principles of Mechanical Science and their Applications. By C. TOMLINSON, F.R.S. Crown 8vo, cloth *1/6*

MECHANICS: CONDENSED. A Selection of Formulæ, Rules,

Tables, and Data for the Use of Engineering Students, &c. By W. G. C. HUGHES, A.M.I.C.E. Crown 8vo, cloth *2/6*

MECHANICS OF AIR MACHINERY. By Dr. J. WIESBACH

and PROF. G. HERRMANN. Authorized Translation with an Appendix on American Practice by A. TROWBRIDGE, Ph.B., Adjunct Professor of Mechanical Engineering, Columbia University. Royal 8vo, cloth: *Net 18/0*

MECHANICS' WORKSHOP COMPANION. Comprising a

great variety of the most useful Rules and Formulæ in Mechanical Science, with numerous Tables of Practical Data and Calculated Results for Facilitating Mechanical Operations. By WILLIAM TEMPLETON, Author of "The Engineer's Practical Assistant," &c., &c. Eighteenth Edition, Revised, Modernised, and considerably Enlarged by W. S. HUTTON, C.E., Author of "The Works' Manager's Handbook," &c. Fcap. 8vo, nearly 500 pp., with 8 Plates and upwards of 250 Diagrams, leather *8/0*

This well-known and long-used book contains information, brought up to date, of the sort so useful to the foreman ch fresh information has been introduced as to constitute it practically a *World*.

MECHANISM AND MACHINE TOOLS. By T. BAKER;

C.E. With Remarks on Tools and Machinery by J. NASMYTH, C.E. Crown 8vo, cloth *2/6*

MENSURATION AND MEASURING. With the Mensuration

and Levelling of Land for the purposes of Modern Engineering. By T. BAKER, C.E. New Edition by E. NUGENT, C.E. Crown 8vo, cloth *1/6*

METAL-TURNING. A Practical Handbook for Engineers,

Technical Students, and Amateurs. By JOSEPH HORNER, A.M.I.Mech.E., Author of "Pattern Making," &c. Large Crown 8vo, cloth, with 488 Illustrations. [Just Published. *Net 9/0*

SUMMARY OF CONTENTS:—INTRODUCTION.—RELATIONS OF TURNERY AND MACHINE SHOP.—SEC. I. THE LATHE, ITS WORK, AND TOOLS.—FORMS AND FUNCTIONS OF TOOLS.—REMARKS ON TURNING IN GENERAL.—SEC. II. TURNING BETWEEN CENTRES.—CENTRING AND DRIVING.—USE OF STEADIES.—EXAMPLES OF TURNING INVOLVING LINING-OUT FOR CENTRES.—MANDREL WORK.—SEC. III. WORK SUPPORTED AT ONE END.—FACE PLATE TURNING.—ANG CHUCKS.—CONCENTRIC, UNIVERSAL, TOGGLE, AL WORK.—DRILLING, BORING, AND ALLIED AND TURRET WORK. —SEC. VI MISCELLAN NT, GRINDING.—TOOL HOLDERS—SPEED AND FEEDS, TOOL STEELS.—STEEL MAKERS' INSTRUCTIONS.

METRIC TABLES. In which the British Standard Measures and Weights are compared with those of the Metric System at present in Use on the Continent. By C. H. DOWLING, C.E. 8vo, cloth . . . **10/6**

MILLING MACHINES; their Design, Construction, and Working. A Handbook for Practical Men and Engineering Students. By JOSEPH HORNER, A.M.I.Mech.E., Author of "Pattern Making," &c. With 260 Illustrations. Medium 8vo, cloth . . . **Net 12/6**

LEADING ELEMENTS OF MILLING MACHINE DESIGN AND CONSTRUCTION. By JOSEPH HORNER, A.M.I.Mech.E., Author of "Pattern Making," &c. With 260 Illustrations. Medium 8vo, cloth . . . **Net 12/6**

MOTOR CARS FOR COMMON ROADS. By A. J. WALLIS-TAYLER, A.M.Inst.C.E. 212 pp., with 76 Illustrations. Crown 8vo, cloth . . . **4/6**

MOTOR VEHICLES FOR BUSINESS PURPOSES. A Practical Handbook for those interested in the Transport of Passengers and Goods. By A. J. WALLIS-TAYLER, A.M.Inst.C.E. With 134 Illustrations. Demy 8vo, cloth . . . **Net 9/0**

NAVAL ARCHITECT'S AND SHIPBUILDER'S POCKET BOOK. Of Formulæ, Rules, and Tables, and Marine Engineer's and Surveyor's Handy Book of Reference. By CLEMENT MACKROW, M.I.N.A. Ninth Edition, Fcap., leather . . . **Net 12/6**

SIGNS AND SYMBOLS, DECIMAL METRY.—MENSURATION.—CENTRES OF GRAVITY.—CENTRES OF INERTIA AND RADII OF GYRATION.—RULES.—MECHANICAL PRINCIPLES.—DISPLACEMENT, CENTRE OF BUOYANCY.—CENTRE OF GRAVITY.—STABILITY CURVES AND METACENTRES.—SEA AND WIND.—ROLLING OF SHIPS.—PROPULSION AND RESISTANCE OF VESSELS.—SPEED TRIALS.—SAILING, CENTRE OF EFFORT.—DISTANCES OF TRAVEL.—RUDDERS OF VESSELS.—LAUNCHING CALCULATIONS.—MATERIAL AND GEAR.—GUN PARTICULARS.—RIVETED JOINTS AND RIVETING.—STRENGTH OF BOLTS AND SHEARING STRESSES.—STRENGTH OF PLATES.—HYDRAULIC DATA.—CONIC SECTIONS.—CATENARIAN CURVES.—MECHANICAL PRINCIPLES.—S.—BOARD OF TRADE REGULATIONS.—LLOYD'S REGISTER.—SHIPS' FITTINGS AND TIMBER.—ALLOYS.—PORT REGULATION.—CENTAGES FOR EXPORT.—DISTANCES OF TRAVEL.—ENGLISH TERMS.—MEASURES.—DECIMAL OF AND CIRCUMFERENCE.—TABLES OF SQUARES AND CUBES AND ROOTS OF NUMBERS.—TABLES OF LOGARITHMS OF NUMBERS.—TABLES OF HYPERBOLIC LOGARITHMS.—TABLES OF NATURAL SINES, TANGENTS, &c.

It contains a full compilation for the use of the surveyor, seaman, &c.

NAVAL ARCHITECTURE. An Exposition of the Elementary Principles. By J. PEAKE. Crown 8vo, cloth . . . **3/6**

NAVIGATION AND NAUTICAL ASTRONOMY, In Theory and Practice. By Prof. J. R. YOUNG. Crown 8vo, cloth . . . **2/6**
"A very complete, thorough, and useful manual for the young navigator."—*Observer*.

NAVIGATION, PRACTICAL. Consisting of the Sailor's Sea Book, by J. GREENWOOD and W. H. ROSSER; together with Mathematical and Nautical Tables for the Working of the Problems, by H. LAW, C.E., and Prof. J. R. YOUNG **7/0**

PATTERN MAKING. Embracing the Main Types of Engineering Construction, and including Gearing, Engine Work, Sheaves and Pulleys, Pipes and Columns, Screws, Machine Parts, Pumps and Cocks, the Moulding of Patterns in Loam and Greensand, Weight of Castings, &c. By J. G. HORNER, A.M.I.M.E. Third Edition, Enlarged. With 486 Illustrations. Crown 8vo, cloth **Net 7/6**

"A well-written technical guide, evidently written by a man who understands and has practised what he has written about."—*Builder*.

PATTERN MAKING. A Practical Work on the Art of Making Patterns for Engineering and Foundry Work, including (among other matter) Materials and Tools, Wood Patterns, Metal Patterns, Pattern Shop Mathematics, Cost, Care, &c., of Patterns. By F. W. BARROWS. Fully Illustrated by Engravings made from Special Drawings by the Author. Crown 8vo, cloth. **Net 6/0**

PATTERN MAKERS AND PATTERN MAKING—MATERIALS AND TOOLS—EXAMPLES OF PATTERN WORK—METAL PATTERNS—PATTERN SHOP MATHEMATICS—COST, CARE, AND INVENTORY OF PATTERNS—MARKING AND RECORD OF PATTERNS—PATTERN ACCOUNTS.

PIONEER ENGINEERING. A Treatise on the Engineering Operations connected with the Settlement of Waste Lands in New Countries. By E. DOBSON, M.Inst.C.E. Second Edition. Crown 8vo, cloth **4/6**

PNEUMATICS, Including Acoustics and the Phenomena of Wind Currents, for the use of Beginners. By CHARLES TOMLINSON, F.R.S. Crown 8vo, cloth **1/6**

PUMPS AND PUMPING. A Handbook for Pump Users. Being Notes on Selection, Construction, and Management. By M. POWIS BALE, M.Inst.C.E., M.I.Mech.E. Fifth Edition. Crown 8vo, cloth . **3/6**

"The matter is set forth as concisely as possible. In fact, condensation rather than diffuseness has been the author's aim throughout; yet he does not seem to have omitted anything likely to be of use."—*Journal of Gas Lighting*.

PUNCHES, DIES, AND TOOLS FOR MANUFACTURING IN PRESSES. By JOSEPH V. WOODWORTH. Medium 8vo, cloth. 482 pages with 700 Illustrations [*Just Published.* **Net 16/0**

SIMPLE BENDING AND FORMING DIES, THEIR CONSTRUCTION, USE AND OPERATION
AND FORMING DIES, FOR ACCURATE AND RAPID
BENDING AND TWISTING DIES AND PUNCHES, FOR
CARRY, AND FOLLOW DIES, TOGETHER WITH
SHEET METAL
AND TOOLS—
PUNCHES AND
CASES OF
AND USE OF
THEIR EVOLUTION AND MANUFACTURE—
MAKING HYDRAULIC PACKING LEATHERS,
CHEMICAL TABLETS—DRAWING, RE-DRAWING,
REDUCING, FLANGING, FORMING, REVERSING, AND CUPPING PROCESSES, PUNCHES AND
DIES FOR CIRCULAR AND RECTANGULAR AND SHEET-METAL ARTICLES—BEADING,
WIRING, CURVE
METAL PARTS
CONSTRUCTION
OF SUB-PRESSES AND SUB-PRESS DIES FOR WATCH AND CLOCK WORK AND ACCURATE
PIERCING AND PUNCHING—DROP FORGING AND DIE SINKING, TOGETHER WITH MAKING
OF DROP DIES, STEAM-HAMMER DIES, NUMBER-PLATE TOOLS AND DIES FOR BOLT
MACHINES—METHODS, DESIGNS, WAYS, KINKS, FORMULAS AND TOOLS FOR SPECIAL
WORK—
—ON OF VALUE TO TOOL AND DIE
—SPECIAL AND NOVEL PROCESSES,
DIES.

RECLAMATION OF LAND FROM TIDAL WATERS.

A Handbook for Engineers, Landed Proprietors, and others interested in Works of Reclamation. By A. BEAZELEY, M.Inst.C.E. 8vo, cloth. *Net 10/6*

"The work contains a great deal of practical and useful information which cannot fail to be of service to engineers entrusted with the enclosure of salt marshes, and to land-owners intending to reclaim land from the sea."—*The Engineer*.

REFRIGERATING AND ICE-MAKING MACHINERY.

A Descriptive Treatise for the Use of Persons Employing Refrigerating and Ice-Making Installations, and others. By A. J. WALLIS-TAYLER, A.M.Inst.C.E. Third Edition, Enlarged. Crown 8vo, cloth. *7/6*

"May be recommended as a useful description of the machinery, the processes, and of the facts, figures, and tabulated physics of refrigerating."—*Engineer*.

REFRIGERATION AND ICE-MAKING POCKET BOOK.

By A. J. WALLIS-TAYLER, A.M.Inst.C.E. Author of "Refrigerating and Ice-making Machinery," &c. Fourth Edition. Crown 8vo, cloth. *Net 3/6*

REFRIGERATION, COLD STORAGE, & ICE-MAKING:

A Practical Treatise on the Art and Science of Refrigeration. By A. J. WALLIS-TAYLER, A.M.Inst.C.E., Author of "Refrigerating and Ice-Making Machinery." 600 pp., with 360 Illustrations. Medium 8vo, cloth. *Net 15/0*

"...production of such an important nothing that would in

RIVER BARS. The Causes of their Formation, and their

Treatment by "Induced Tidal Scour"; with a Description of the Successful Reduction by this Method of the Bar at Dublin. By I. J. MANN, Assist. Eng. to the Dublin Port and Docks Board. Royal 8vo, cloth. *7/6*

"We recommend all interested in harbour works—and, indeed, those concerned in the improvements of rivers generally—to read Mr. Mann's interesting work."—*Engineer*.

ROADS AND STREETS. By H. LAW, C.E., and D. K. CLARK,

C.E. Revised, with Additional Chapters by A. J. WALLIS-TAYLER, A.M.Inst.C.E. Seventh Edition. Crown 8vo, cloth. *6/0*

"A book which every borough surveyor and engineer must possess, and which will be of considerable service to architects, builders, and property owners generally."—*Building News*.

ROOFS OF WOOD AND IRON. Deduced chiefly from the

Works of Robison, Tredgold, and Humber. By E. W. TARN, M.A., Architect. Fifth Edition. Crown 8vo, cloth. *1/6*

SAFE RAILWAY WORKING. A Treatise on Railway Acci-

dents, their Cause and Prevention; with a Description of Modern Appliances and Systems. By CLEMENT E. STRETTON, C.E. Third Edition, Enlarged. Crown 8vo, cloth. *3/6*

SAFE USE OF STEAM. Containing Rules for Unprofes-

sional Steam Users. By an ENGINEER. Eighth Edition. Sewed. *6d.*

"If steam-users would but learn this little book by heart, holler explosions would become sensations by their rarity."—*English Mechanic*.

SAILMAKING. By SAMUEL B. SADLER, Practical Sailmaker, late in the employment of Messrs. Ratsey and Lapthorne, of Cowes and Gosport. Second Edition. Revised and Enlarged. Plates. 4to, cloth . . . *Net 12/6*

SAILOR'S SEA BOOK. A Rudimentary Treatise on Navigation. By JAMES GREENWOOD, B.A. With numerous Woodcuts and Coloured Plates. New and Enlarged Edition. By W. H. ROSSER. Crown 8vo, cloth *2/6*

SAILS AND SAIL-MAKING. With Draughting, and the Centre of Effort of the Sails. Weights and Sizes of Ropes; Mastng, Rigging, and Sails of Steam Vessels, etc. By R. KIPPING, N.A. Crown 8vo, cloth *2/6*

SCREW-THREADS, and Methods of Producing Them. With numerous Tables and complete Directions for using Screw-Cutting Lathes. By PAUL N. HASLICK, Author of "Lathe-Work," etc. Sixth Edition. Waistcoat-pocket size *1/6*
 "Full of useful information, hints and practical criticism. Taps, dies, and screwing tools generally are illustrated and their action described."—*Mechanical World*.

SEA TERMS, PHRASES, AND WORDS (Technical Dictionary (French-English, English-French), used in the English and French Languages. For the Use of Seamen, Engineers, Pilots, Shipbuilders, Ship-owners, and Shipbrokers. Compiled by W. PIRRIE, late of the African Steamship Company. Fcap. 8vo, cloth *5/0*

SHIPBUILDING INDUSTRY OF GERMANY. Compiled and Edited by G. LEHMANN-FELSKOWSKI. With Coloured Prints, Art Supplements, and numerous Illustrations throughout the text. Super-royal 4to, cloth *Net 10/6*

SHIPS AND BOATS. By W. BLAND. With numerous Illustrations and Models. Tenth Edition. Crown 8vo, cloth . . . *1/6*

SHIPS FOR OCEAN AND RIVER SERVICE. Principles of the Construction of. By H. A. SOMMERFELDT. Crown 8vo . . . *1/6*
 ATLAS OF ENGRAVINGS to illustrate the above. Twelve large folding Plates. Royal 4to, cloth *7/6*

SMITHY AND FORGE. Including the Farrier's Art and Coach Smithing. By W. J. E. CRANE. Crown 8vo, cloth . . . *2/6*

STATICS, GRAPHIC AND ANALYTIC. In their Practical Application to the Treatment of Stresses in Roofs, Solid Girders, Lattice, Bowstring, and Suspension Bridges, Braced Iron Arches and Piers, and other Frameworks. By R. HUDSON GRAHAM, C.E. Containing Diagrams and Plates to Scale. With numerous Examples, many taken from existing Structures. Specially arranged for Class-work in Colleges and Universities. Second Edition, Revised and Enlarged. 8vo, cloth *16/0*

"Mr. Graham's book will find a place wherever graphic and analytic statics are used or studied."—*Engineer*.

STATIONARY ENGINE DRIVING. A Practical Manual for Engineers in Charge of Stationary Engines. By MICHAEL REYNOLDS, M.S.E. Seventh Edition. Crown 8vo, cloth, **3/6**; cloth boards. **4/6**

"The author is thoroughly acquainted with his subjects, and has produced a manual which is an exceedingly useful one for the class for whom it is specially intended."—*Engineering*.

STATIONARY ENGINES. A Practical Handbook of their Care and Management for Men-in-charge. By C. HURST. Crown 8vo. *Net* **1/0**

STEAM AND THE STEAM ENGINE. Portable. Being an Extension of the Treatise on the Steam Engine. By Mr. J. SEWELL. By D. K. CLARK, C.E. Fourth Edition. Crown 8vo, cloth. **3/6**

"Every essential part of the subject is treated of competently, and in a popular style."—*Iron*.

STEAM AND MACHINERY MANAGEMENT. A Guide to the Arrangement and Economical Management of Machinery, with Hints on Construction and Selection. By M. POWIS BALE, M.Inst.M.E. Crown 8vo, cloth. **2/6**

"Gives the results of wide experience."—*Lloyd's Newspaper*.

STEAM ENGINE. A Practical Handbook compiled with especial Reference to Small and Medium-sized Engines. For the Use of Engine Makers, Mechanical Draughtsmen, Engineering Students, and users of Steam Power. By HERMAN HAEDER, C.E. Translated from the German with additions and alterations, by H. H. P. POWLES, A.M.I.C.E., M.I.M.E. Third Edition, Revised. With nearly 1,200 Illustrations. Crown 8vo, cloth. *Net* **7/6**

"This is an excellent book, and should be in the hands of all who are interested in the construction and management of steam engines. It leads to the conclusion that the steam engine aims at showing the result of a complete achievement of this idea."—*Nature*.

STEAM ENGINE. A Treatise on the Mathematical Theory of, with Rules and Examples for Practical Men. By T. BAKER, C.E. Crown 8vo, cloth. **1/6**

"Teems with scientific information with reference to the steam-engine."—*Design and Work*.

STEAM ENGINE. For the Use of Beginners. By Dr. LARDNER. Crown 8vo, cloth. **1/6**

STEAM ENGINE. A Text-Book on the Steam Engine, with a Supplement on GAS ENGINES and PART II. on HEAT ENGINES. By T. M. GOODEVE, M.A., Barrister-at-Law, Professor of Mechanics at the Royal College of Science, London; Author of "The Principles of Mechanics," "The Elements of Mechanism," etc. Fourteenth Edition. Crown 8vo, cloth. **6/0**

"Professor Goodeve has given us a treatise on the steam engine, which will bear comparison with anything written by Huxley or Maxwell, and we can award it no higher praise."—*Engineer*.

"Mr. Goodeve's text-book is a work of which every young engineer should possess himself."—*Mining Journal*.

STEAM ENGINE (PORTABLE.) A Practical Manual on its Construction and Management. For the use of Owners and Users of Steam Engines generally. By WILLIAM DYSON WANSBROUGH. Crown 8vo, cloth **3/6**

"This is a work of value to those who use steam machinery. . . . Should be read by every one who has a steam engine, on a farm or elsewhere."—*Mark Lane Express*.

STEAM ENGINEERING IN THEORY AND PRACTICE.

By GARDNER D. HISCOX, M.E. With Chapters on "Boilers," "Engines," "Pumps," "Steam," "Electricity," "Switchboards," 450 Pages. Over 400 Detailed Engravings

[just published. Net **12/6**

HISTORICAL—STEAM AND ITS PROPERTIES—APPLIANCES FOR THE GENERATION OF STEAM—TYPES OF BOILERS—CHIMNEY AND ITS WORK—HEAT ECONOMY OF THE FRESH WATER—STEAM PUMPS AND THEIR WORK—INCUSTATION AND ITS WORK—STEAM ABOVE ATMOSPHERIC PRESSURE—FLOW OF STEAM FROM NOZZLES—SUPER-HEATED STEAM—AND ITS WORK—ADIABATIC EXPANSION OF STEAM—INDICATOR AND ITS WORK—SLIDE VALVE PROPORTIONS—SLIDE VALVE ENGINES AND VALVE MOTION—CORRUGATED STEAM AND ITS VALVE GEAR—COMPOUND ENGINE AND ITS THEORY—TRIPPLE AND CORRISSON EXPANSION ENGINE—STEAM TURBINE—REFRIGERATION—ELEVATORS AND CONVEYERS—MANAGEMENT—COST OF POWER—STEAM ENGINE TROUBLES—ELECTRIC POWER AND ELECTRIC PLANTS.

STONE BLASTING AND QUARRYING. For Building and other Purposes. With Remarks on the Blowing up of Bridges. By Gen. Sir J. BURGVOYNE, K.C.B. Crown 8vo, cloth **1/6**

STONE-WORKING MACHINERY. A Manual dealing with the Rapid and Economical Conversion of Stone. With Hints on the Arrangement and Management of Stone Works. By M. POWIS BALE, M.Inst.C.E. Crown 8vo, cloth **9/0**

"Should be in the hands of every mason or student of stonework."—*Colliery Guardian*.

STRAINS, HANDY BOOK FOR THE CALCULATION OF.

In Girders and Similar Structures and their Strength. Consisting of Formulæ and Corresponding Diagrams, with numerous details for Practical Application, &c. By WILLIAM HUMBER, A. M.Inst.C.E., &c. Sixth Edition. Crown 8vo, with nearly 100 Woodcuts and 3 Plates, cloth **7/6**

"We heartily commend this really *handy* book to our engineer and architect readers."—*English Mechanic*.

STRAINS ON STRUCTURES OF IRONWORK. With Practical Remarks on Iron Construction. By F. W. SHEILDS, M.Inst.C.E. 8vo, cloth **5/0**

SUBMARINE TELEGRAPHS. Their History, Construction, and Working. Founded in part on WÜNSCHENDORFF'S "Traité de Télégraphie Sous-Marine," and Compiled from Authoritative and Exclusive Sources. By CHARLES BRIGHT, F.R.S.E., A.M.Inst.C.E., M.I.Mech.E., M.I.E.E. Super royal 8vo, nearly 800 pages, fully illustrated, including a large number of Maps and Folding Plates, strongly bound in cloth **Net £3 3s.**

"Mr. Bright's interestingly written and admirably illustrated book will meet with a welcome reception from cable men."—*Electrician*.

SURVEYING AS PRACTISED BY CIVIL ENGINEERS

AND SURVEYORS. Including the Setting-out of Works for Construction and Surveys Abroad, with many Examples taken from Actual Practice. A Handbook for use in the Field and the Office, intended also as a Text-book for Students. By JOHN WHITEHEAD, Jun., A.M. Inst.C.E., Author of "Points and Crossings." With about 260 Illustrations. Second Edition. Demy 8vo, cloth *Net 10/6*

OF ANGULAR
(INCLUDING
TUNNEL
HYDROGRA-
N SURVEYING
NGLE, DENSE
TIC SURVEYS.

"This work is written with admirable lucidity, and will certainly be found of distinct value both to students and to those engaged in actual practice."—*The Builder*.

SURVEYING, LAND AND ENGINEERING.

For Students and Practical Use. By T. BAKER, C.E. Twentieth Edition, by F. E. Dixon, A.M. Inst.C.E. With Plates and Diagrams. Crown 8vo, cloth *2/0*

SURVEYING, LAND AND MARINE.

In Reference to the Preparation of Plans for Roads and Railways; Canals, Rivers, Towns, Water Supplies; Docks and Harbours. With Description and Use of Surveying Instruments. By W. DAVIS HASKOLL, C.E. Second Edition, Revised with Additions. Large crown 8vo, cloth *9/0*

"This book must prove of great value to the student. We have no hesitation in recommending it, feeling assured that it will more than repay a careful study."—*Mechanical World*.

SURVEYING, PRACTICAL.

A Text-book for Students Preparing for Examinations or for Survey Work in the Colonies. By GEORGE W. USILL, A.M. Inst.C.E. Eighth Edition, thoroughly Revised and Enlarged by ALIX. BEAZLEY, M. Inst.C.E. With 4 Lithographic Plates and 360 Illustrations. Large crown 8vo, *7/6* cloth; or, on thin paper, leather, gilt edges, rounded corners, for pocket use *12/6*

ORDINARY QUIRRED IN
SURVEYING— TOWN-
SURVEYING— WORK—
LAND QUANTITY TABLES—
INCREASING TABLES OF NATURAL SINES, ETC.—NATURAL SINES AND CO-SINES
—NATURAL TANGENTS AND CO-TANGENTS—NATURAL SECANTS AND CO-SECANTS

"The first book which should be put in the hands of a pupil of civil engineering."—*Architect*.

SURVEYING TRIGONOMETRICAL.

An outline of the Method of Conducting a Trigonometrical Survey. For the Formation of Geographical and Topographical Maps and Plans, Military Reconnaissance, Levelling, &c., with Useful Problems, Formulae, and Tables. By Lieut.-General FROME, R.E. Fourth Edition, Revised and partly Re-written by Major-General Sir CHARLES WARREN, G.C.M.G., R.E. With 19 Plates and 115 Woodcuts, royal 8vo, cloth *16/0*

SURVEYING WITH THE TACHEOMETER.

A Practical Manual for the use of Civil and Military Engineers and Surveyors, including two series of Tables specially computed for the Reduction of Readings in Sexagesimal and in Centesimal Degrees. By NIEL KENNEDY, M. Inst.C.E., With Diagrams and Plates. Second Edition. Demy 8vo, cloth *Net 10/6*

"The work is very clearly written, and should remove all difficulties in the way of any surveyor desirous of making use of this useful and rapid instrument."—*Nature*.

SURVEY PRACTICE. For Reference in Surveying, Levelling, and Setting-out; and in Route Surveys of Travellers by Land and Sea. With Tables, Illustrations, and Records. By L. D'A. JACKSON, A.M.Inst.C.E. Second Edition. 8vo, cloth **12/6**

SURVEYOR'S FIELD BOOK FOR ENGINEERS AND MINING SURVEYORS: Consisting of a Series of Tables, with Rules, Explanations of Systems, and use of Theodolite for Traverse Surveying and plotting the work with minute accuracy by means of Straight Edge and Set Square only; Levelling with the Theodolite, Setting-out Curves with and without the Theodolite, Earthwork Tables, &c. By W. DAVIS HASKOLL, C.E. With numerous Woodcuts Fifth Edition, Enlarged. Crown 8vo, cloth **12/0**

"The book is very handy; the separate tables of sines and tangents to every minute will make it useful for many other purposes, the genuine traverse tables existing all the same."—*Athenæum*.

TECHNICAL TERMS, English-French, French-English: A Pocket Glossary; with Tables suitable for the Architectural, Engineering, Manufacturing, and Nautical Professions. By JOHN JAMES FLETCHER. Fourth Edition, 200 pp. Waistcoat-pocket size, limp leather **1/6**

"The glossary of terms is very complete, and many of the Tables are new and well arranged. We cordially commend the book."—*Mechanical World*.

TOOLS FOR ENGINEERS AND WOODWORKERS. Including Modern Instruments of Measurement. By JOSEPH HORNER, A.M.Inst.M.E., Author of "Pattern Making," &c. Demy 8vo, with 456 Illustrations **Net 9/0**

SUR-
ANGLES.
—PLANE
TOOLS F
FOR MEASUREMENT AND TEST.
PLATES, LEVELS, BEVELS, PRO-
—COMPASSES AND
—MICROMETER
LIMIT GAUGES.

"As an all-round practical work on tools it is more comprehensive than any with which we are acquainted, and we have no doubt it will meet with the large measure of success to which its merits fully entitle it."—*Mechanical World*.

TOOTHED GEARING. A Practical Handbook for Offices, and Workshops. By J. HORNER, A.M.I.M.E. Second Edition, with a New Chapter on Recent Practice. With 184 Illustrations. Crown 8vo, cloth **6/0**

TRAMWAYS: THEIR CONSTRUCTION AND WORKING. Embracing a Comprehensive History of the System; with an exhaustive Analysis of the Various Modes of Traction, including Horse Power, Steam, Cable Traction, Electric Traction, &c.; a Description of the Varieties of Rolling Stock; and ample Details of Cost and Working Expenses. New Edition, Thoroughly Revised, and including the Progress recently made in Tramway Construction, &c. By D. KINNEAR CLARK, M.Inst.C.E. With 400 Illustrations. 8vo, 780 pp., buckram. **28/0**

TRUSSES OF WOOD AND IRON. Practical Applications of Science in Determining the Stresses, Breaking Weights, Safe Loads, Scantlings, and Details of Construction. With Complete Working Drawings. By W. GRIFFITHS, Surveyor. Oblong 8vo, cloth **4/6**
 "This handy little book enters so minutely into every detail connected with the construction of roof trusses that no student need be ignorant of these matters."—*Practical Engineer*.

TUNNELLING. A Practical Treatise, By CHARLES PRELINI, C.E. With additions by CHARLES S. HILL, C.E. With 150 Diagrams and Illustrations. Royal 8vo, cloth **Net 16/0**

TUNNELLING, PRACTICAL. Explaining in detail the Setting-out the Works, Shaft-sinking, and Heading-driving, Ranging the Lines and Levelling underground, Sub-Excavating, Timbering and the Construction of the Brickwork of Tunnels. By F. W. SIMMS, M.Inst.C.E. Fourth Edition, Revised and Further Extended, including the most recent (1895) Examples of Sub-aqueous and other Tunnels, by D. KINNAR CLARK, M.Inst.C.E. With 34 Folding Plates. Imperial 8vo, cloth **£2 2s.**

TUNNEL SHAFTS. A Practical and Theoretical Essay on the construction of large Tunnel Shafts. By J. H. WATSON BUCK, M.Inst.C.E., Resident Engineer, L. and N. W. R. With Folding Plates, 8vo, cloth **12/0**
 "Will be regarded by civil engineers as of the utmost value and calculated to save much time and obviate many mistakes."—*Colliery Guardian*.

WAGES TABLES. At 54, 52, 50, and 48 Hours per Week, Showing the Amounts of Wages from One quarter of an hour to Sixty-four hours, in each case at Rates of Wages advancing by One Shilling from 4s. to 55s. per week. By THOS. GARBUTT, Accountant. Square crown 8vo, half-bound **8/0**

WATER ENGINEERING. A Practical Treatise on the Measurement, Storage, Conveyance, and Utilization of Water for the Supply of Towns, for Mill Power, and for other Purposes. By CHARLES SLAGG, A.M.Inst.C.E. Second Edition. Crown 8vo, cloth **7/6**

WATER, POWER OF. As Applied to Drive Flour Mills and to give motion to Turbines and other Hydrostatic Engines. By JOSEPH GLYNN, F.R.S., &c. New Edition. Illustrated. Crown 8vo, cloth **2/0**

WATER SUPPLY OF CITIES AND TOWNS. By WILLIAM HUMBER, A.M.Inst. C.E., and M.Inst.M.E., Author of "Cast and Wrought Iron Bridge Construction," &c., &c. Illustrated with 50 Double Plates, 1 Single Plate, Coloured Frontispiece, and upwards of 250 Woodcuts, and containing 400 pp. of Text. Imp. 4to, elegantly and substantially half-bound in morocco **Net £6 6s.**

LIST OF CONTENTS:—I. HISTORICAL SKETCH OF SOME OF THE MEANS THAT HAVE BEEN ADOPTED FOR THE SUPPLY OF WATER TO CITIES AND TOWNS.—II. WATER AND THE FOREIGN MATTER USUALLY ASSOCIATED WITH IT.—III. RAINFALL AND EVAPORATION.—IV. SPRINGS AND THE WATER.—V. MEASUREMENT AND ESTIMATION OF THE QUANTITY OF WATER.—VI. DISTRIBUTION OF WATER.—VII. THE LAW OF SUPPLY.—VIII. VELOCITIES, &c., &c.—IX. TABLES OF RATES OF SUPPLY, &c.—X. OF SEVERAL WORKS ILLUSTRATED, AMONG WHICH ARE, DUNDEE, HALIFAX, LAMBETH, ROTHERHAM, DUBLIN, AND OTHERS.

"The most systematic and valuable work upon water supply hitherto produced in English, or in any language. Mr. Humber's work is characterised almost throughout by an exhaustiveness much more distinctive of French and German than of English technical treatises."—*Engineer*.

WATER SUPPLY OF TOWNS AND THE CONSTRUCTION OF WATER-WORKS. A Practical Treatise for the Use of

I. INTRODUCTORY.—II. DIFFERENT QUALITIES OF WATER.—III. QUANTITY OF WATER TO BE PROVIDED.—IV. ON ASCERTAINING WHETHER A PROPOSED SOURCE OF SUPPLY IS SUFFICIENT.—V. ON ESTIMATING THE STORAGE CAPACITY REQUIRED TO BE PROVIDED.—VI. CLASSIFICATION OF WATER-WORKS.—VII. IMPOUNDING RESERVOIRS.—VIII. EARTHWORK DAMS.—IX. MASONRY DAMS.—X. THE PURIFICATION OF WATER.—XI. SETTLING RESERVOIRS.—XII. SAND FILTRATION.—XIII. PURIFICATION OF WATER BY ACTION OF IRON, SOFTENING OF WATER BY ACTION OF LIME, NATURAL FILTRATION.—XIV. SERVICE OR CLEAN WATER RESERVOIRS.—XV. WATER TOWERS—STAND PIPES.—XVI. THE CONNECTION OF SETTLING RESERVOIRS, FILTER BEDS AND SERVICE PIPES.—XVII. THE CONNECTION OF SERVICE PIPES.—XVIII. FLOW OF WATER IN CONDUITS AND OPEN CHANNELS.—XIX. DISTRIBUTION SYSTEMS.—XX. SPECIAL PROVISIONS FOR THE EXTINCTION OF FIRES.—XXI. PIPES FOR WATER-WORKS.—XXII. PREVENTION OF WASTE OF WATER.—XXIII. VARIOUS APPLIANCES USED IN CONNECTION WITH WATER-WORKS.

APPENDIX I. By PROF. JOHN MILNE, F.R.S.—CONSIDERATIONS CONCERNING THE PROBABLE EFFECTS OF EARTHQUAKES ON WATER-WORKS, AND THE SPECIAL PRECAUTIONS TO BE TAKEN IN EARTHQUAKE COUNTRIES.

APPENDIX II. By JOHN DE RIJKE, C.E.—ON SAND DUNES AND DUNE SANDS AS
A SOURCE OF WATER SUPPLY.

"We congratulate the author upon the practical commonsense shown in the preparation of this work. . . . The plates and diagrams have evidently been prepared with great care, and cannot fail to be of great assistance to the student."—*Builder*.

WATER SUPPLY, RURAL. A Practical Handbook on the Supply of Water and Construction of Waterworks for small Country Districts. By ALLAN GREENWELL, A.M.Inst.C.E. and W. T. CURRY, A.M.Inst.C.E., F.G.S. With Illustrations. Second Edition, Revised. Crown 8vo, cloth 5/0

"The volume contains valuable information upon all matters connected with water supply. It is full of details on points which are continually before water-works engineers."—*Nature*.

WELLS AND WELL-SINKING. By J. G. SWINDELL,
A.R.I.B.A., and G. R. BURNELL, C.E. Revised Edition. Crown 8vo.
cloth 2/0

WIRELESS TELEGRAPHY: ITS THEORY AND PRACTICE. A Handbook for the use of Electrical Engineers, Students, and Operators. By JAMES ERSKINE-MURRAY, D.Sc., Fellow of the Royal Society of Edinburgh, Member of the Institution of Electrical Engineers. Demy 8vo, 338 pages, with over 130 Diagrams and Illustrations. *Just Published.* Net 10/6

ADAM...
AT WIRE...
QUENCY...
MEANS OF...
OF HIGHER...
TRACTORS...
THE MARC...
THE HOZIE...
SYSTEM-TH...
SOME POINT...
WORLD-WAVE...
FINDING-ON...
TABLES AND NOTES.

TABLES AND NOTES. A serious and meritorious contribution to the literature on this subject. The author brings to hear not only the facts of the variation of the phenomena of physical telegraph stations, but also the originality of the physical phenomena of the physical telegraph stations.

WIRELESS TELEGRAPHY; Its Origins, Development, Inventions, and Apparatus. By CHARLES HENRY SEWALL, Author of "Patented Telephony," "The Future of Long-Distance Communication." With 85 Diagrams and Illustrations. Demy 8vo, cloth **Net 10/6**

WIRELESS TELEPHONY, A HISTORY OF. By ERNST RUHMER. Translated from the German by J. ERSKINE-MURRAY, D.Sc., M.I.E.E., &c. Author of "A Handbook of Wireless Telegraphy." With numerous Illustrations. Demy, 8vo., cloth.
[Nearly ready. Price about net **9/0**

WORKSHOP PRACTICE. As applied to Marine, Land, and Locomotive Engines, Floating Docks, Dredging Machines, Bridges, Ship building, &c. By J. G. WINTON. Fourth Edition, Illustrated. Crown 8vo, cloth **3/6**

WORKS' MANAGER'S HANDBOOK. Comprising Modern Rules, Tables, and Data. For Engineers, Millwrights, and Boiler Makers; Tool Makers, Machinists, and Metal Workers; Iron and Brass Founders, &c. By W. S. HUTTON, Civil and Mechanical Engineer, Author of "The Practical Engineer's Handbook." Seventh Edition, carefully Revised, and Enlarged. Medium 8vo, strongly bound [Just published **15/0**

S
OIL-ENGINE, ETC.—
MILLS, VALVES,
FACTORY, JETTING,
AND I JETTING,
ETC.—

"The volume is an exceedingly useful one, brimful with engineer's notes, memoranda, and rules, and well worthy of being on every mechanical engineer's bookshelf."—*Mechanical World*.

PUBLICATIONS OF THE ENGINEERING STANDARDS COMMITTEE.

MESSRS. CROSBY LOCKWOOD and SON, having been appointed OFFICIAL PUBLISHERS to the ENGINEERING STANDARDS COMMITTEE, beg to invite attention to the List given below of the Publications already issued by the Committee, and will be prepared to supply copies thereof and of all Subsequent Publications as issued.

THE ENGINEERING STANDARDS COMMITTEE is the outcome of a Committee appointed by the Institution of Civil Engineers at the instance of Sir John Wolfe Barry, K.C.B., to inquire into the advisability of Standardising Rolled Iron and Steel Sections.

The Committee as now constituted is supported by the Institution of Civil Engineers, the Institution of Mechanical Engineers, the Institution of Naval Architects, the Iron and Steel Institute, and the Institution of Electrical Engineers; and the value and importance of its labours—not only to the Engineering profession, but to the country at large—has been emphatically recognised by His Majesty's Government, who have made a liberal grant from the Public Funds by way of contribution to the financial resources of the Committee, and have placed at its disposal the services (on the several Sub-Committees) of public officials of the highest standing selected from various Government Departments.

The subjects already dealt with, or under consideration by the Committee, include not only Rolled Iron and Steel Sections, but Tests for Iron and Steel Material used in the Construction of Ships and their Machinery, Bridges and General Building Construction, Railway Rolling Stock, Undercarriages, Components and Parts of Locomotives, Railway and Tramway Rails, Materials, Screw Threads and Limit Gauges, Pipe Flanges, Cement, etc.

These particulars will be sufficient to show the importance to the Trade and Industries of the Empire of the work the Committee has undertaken.

Reports already Published :—

1. **BRITISH STANDARD SECTIONS** (9 lists).—ANGLES, EQUAL AND UNEQUAL.—BULB ANGLES, TEES AND PLATES.—Z AND T BARS.—CHANNELS.—BEAMS. Net 1/0
2. **TRAMWAY RAILS AND FISH-PLATES.** Net 21/0
3. **REPORT ON THE INFLUENCE OF GAUGE LENGTH.** Net 2/6
By Professor W. C. UNWIN, F.R.S.
4. **PROPERTIES OF STANDARD BEAMS.** Net 1/0
(Included in No. 6.)
5. **STANDARD LOCOMOTIVES FOR INDIAN RAILWAYS.** Net 10/6
6. **PROPERTIES OF BRITISH STANDARD SECTIONS.** Net 5/0
Diagrams, Definitions, Tables, and Formulæ.
7. **TABLES OF COPPER CONDUCTORS AND THICKNESSES OF DI-ELECTRIC.** Net 2/8
8. **TUBULAR TRAMWAY POLES.** Net 5/0
9. **BULL-HEADED RAILWAY RAILS.** Net 10/6
10. **TABLES OF PIPE FLANGES.** Net 2/6
11. **FLAT-BOTTOMED RAILWAY RAILS.** Net 10/6
12. **SPECIFICATION FOR PORTLAND CEMENT.** Net 2/6
13. **STRUCTURAL STEEL FOR SHIPBUILDING.** Net 2/6

[P.T.O.]

PUBLICATIONS OF THE ENGINEERING STANDARDS COMMITTEE—(*continued*).

14. STRUCTURAL STEEL FOR MARINE BOILERS. *Net 2/6*
15. STRUCTURAL STEEL FOR BRIDGES AND GENERAL BUILDING CONSTRUCTION. . . . *Net 2/6*
16. SPECIFICATIONS AND TABLES FOR TELEGRAPH MATERIALS. *Net 10/6*
17. INTERIM REPORT ON ELECTRICAL MACHINERY. *Net 2/6*
19. REPORT ON TEMPERATURE EXPERIMENTS ON FIELD COILS OF ELECTRICAL MACHINES. *Net 5/0*
20. BRITISH STANDARD SCREW THREADS. *Net 2/6*
21. BRITISH STANDARD PIPE THREADS. *Net 2/6*
22. THE EFFECT OF TEMPERATURE ON INSULATING MATERIALS. *Net 5/0*
23. STANDARDS FOR TROLLEY GROOVE AND WIRE. *Net 1/0*
24. MATERIAL USED IN THE CONSTRUCTION OF RAILWAY ROLLING STOCK. *Net 10/6*
25. ERRORS IN WORKMANSHIP. Based on Measurements carried out by the National Physical Laboratory. *Net 10/6*
26. SECOND REPORT ON LOCOMOTIVES FOR INDIAN RAILWAYS *Net 10/6*
27. STANDARD SYSTEMS FOR LIMIT GAUGES. (Running Fits) *Net 2/6*
28. NUTS, BOLT-HEADS, AND SPANNERS. *Net 2/6*
29. INGOT STEEL FORGINGS FOR MARINE PURPOSES. *Net 2/6*
30. INGOT STEEL CASTINGS FOR MARINE PURPOSES *Net 2/6*
31. STEEL CONDUITS FOR ELECTRICAL WIRING. *Net 2/6*
32. STEEL BARS (for use in automatic Machines.) *Net 2/6*
33. CARBON FILAMENT GLOW LAMPS. *Net 5/0*
34. WHITWORTH, FINE, AND PIPE THREADS. (Mounted on Card and varnished.) *Net 60.*
35. COPPER ALLOY BARS (for use in Automatic Machines). *Net 2/6*
36. STANDARDS FOR ELECTRICAL MACHINERY. 2nd Report *Net 1/0*
38. LIMIT GAUGES FOR SCREW THREADS. *Net 1/0*
39. COMBINED REPORTS ON SCREW THREADS (containing Nos. 20, 28, 38) *Net 3/6*

London : Crosby Lockwood & Son,
7 STATIONERS' HALL COURT, E.C.

WEALE'S SCIENTIFIC & TECHNICAL SERIES.

MATHEMATICS, ARITHMETIC, &c.

Geometry, Descriptive. J. F. HEATHER	2/-
Practical Plane Geometry. J. F. HEATHER.	2/-
Analytical Geometry. J. HANN & J. R. YOUNG.	2/-
Geometry. Part I. (Euclid, Bks. I.—III.) H. LAW	1/6
Part II. (Euclid, Books IV., V., VI., XI., XII.). H. LAW	1/6
Geometry, in 1 vol. (Euclid's Elements)	2/6
Plane Trigonometry. J. HANN	1/6
Spherical Trigonometry. J. HANN	1/-
The above 2 vols., bound together	2/6
Differential Calculus. W. S. B. WOOLHOUSE	1/6
Integral Calculus. H. COX	1/-
Algebra. J. HADDON	2/-
Key to ditto	1/6
Book-keeping. J. HADDON	1/6
Arithmetic. J. R. YOUNG	1/6
Key to ditto	1/6
Equational Arithmetic. W. HIPSELEY	1/6
Arithmetic. J. HADDON	1/6
Key to ditto	1/6
Mathematical Instruments. HEATHER & WALMSLEY	2/-
Drawing & Measuring Instruments. J. F. HEATHER	1/6
Optical Instruments. J. F. HEATHER	1/6
Surveying & Astronomical Instruments. J. F. HEATHER	1/6
The above 3 vols., bound together	4/6
Mensuration and Measuring. T. BAKER	1/6
Slide Rule, & How to Use it. C. HOARE	2/6
Measures, Weights, & Moneys. W. S. B. WOOLHOUSE	2/6
Logarithms, Treatise on, with Tables. H. LAW	3/-
Compound Interest and Annuities. F. THOMAN	4/-
Compendious Calculator. D. O'GORMAN	2/6
Mathematics. F. CAMPIN	3/-
Astronomy. R. MAIN & W. T. LYNN	2/-
Statics and Dynamics. T. BAKER	1/6
Superficial Measurement. J. HAWKINGS	3/6

CROSBY LOCKWOOD & SON, 7, Stationers' Hall Court, E.C.

WEALE'S SCIENTIFIC & TECHNICAL SERIES.

BUILDING & ARCHITECTURE.

Building Estates. F. MAITLAND	2/-
Science of Building. E. W. TARN	3/6
Building, Art of. E. DOBSON and J. P. ALLEN	2/-
Book on Building. Sir E. BECKETT	4/6
Dwelling Houses, Erection of. S. H. BROOKS	2/6
Cottage Building. C. B. ALLEN	2/-
Acoustics of Public Buildings. Prof. T. R. SMITH.	1/6
Practical Bricklaying. A. HAMMOND	1/6
Practical Brick Cutting & Setting. A. HAMMOND.	1/6
Brickwork, F. WALKER	1/6
Brick and Tile Making. E. DOBSON.	3/-
Practical Brick & Tile Book. DOBSON & HAMMOND	6/-
Carpentry and Joinery. T. TREDGOLD & E. W. TARN	3/6
Atlas of 35 plates to the above	6/-
Handrailing, and Staircasing. G. COLLINGS	2/6
Circular Work in Carpentry. G. COLLINGS	2/6
Roof Carpentry. G. COLLINGS	2/-
Construction of Roofs. E. W. TARN	1/6
Joints used by Builders. J. W. CHRISTY	3/-
Shoring. G. H. BLAGROVE	1/6
Timber Importers & Builder's Guide. R. E. GRANDY	2/-
Plumbing. W. P. BUCHAN	3/6
Ventilation of Buildings. W. P. BUCHAN	3/6
Practical Plastering. W. KEMP	2/-
House-Painting. E. A. DAVIDSON	5/-
Elementary Decoration. J. W. FACEY	2/-
Practical House Decoration. J. W. FACEY	2/6
Gas-Fitting. J. BLACK	2/6
Portland Cement for Users. H. FAJJA & D. B. BUTLER	3/-
Limes, Cements, & Mortars. G. R. BURNELL	1/6
Masonry and Stone Cutting. E. DOBSON	2/6
Arches, Piers, and Buttresses. W. BLAND	1/6
Quantities and Measurements. A. C. BEATON	1/6
Complete Measurer. R. HORTON	4/-
Superficial Measurement. J. HAWKINGS	3/6
Light, for use of Architects. E. W. TARN	1/6
Hints to Young Architects. WIGHTWICK & GUILLAUME	3/6
Dictionary of Architectural Terms. J. WEALE	5/-

CROSBY LOCKWOOD & SON, 7, Stationers' Hall Court, E.C.